

LANCE R. LEFLEUR
DIRECTOR



ROBERT J. BENTLEY
GOVERNOR

Alabama Department of Environmental Management
adem.alabama.gov

1400 Coliseum Blvd. 36110-2400 ■ Post Office Box 301463
Montgomery, Alabama 36130-1463
(334) 271-7700 ■ FAX (334) 271-7950

SEP 10 2013

Mr. Robert J. Pickney, Chief Technical Officer
Alabama Wastewater Systems, Inc.
851 Aviation Parkway
Smyrna, TN 37167

RE: Draft Permit
NPDES Permit No. AL0079634
Pine Forest WWTF
Montgomery County, Alabama

Dear Mr. Pickney:

Transmitted herein is a draft of the referenced permit.

We would appreciate your comments on the permit within **30 days** of the date of this letter. Please direct any comments of a technical or administrative nature to the undersigned.

By copy of this letter and the draft permit, we are also requesting comments within the same time frame from EPA.

Please be aware that, if you are not already participating in the Department's web-based electronic environmental (E2) reporting system for submittal of discharge monitoring reports (DMRs), Part I.C.1.c of your permit will require you to apply for participation in the E2 DMR system within 180 days of the effective date of the permit unless valid justification as to why you cannot participate is submitted in writing. The E2 DMR system allows ADEM to electronically validate, acknowledge receipt, and upload data to the state's central wastewater database. This improves the accuracy of reported compliance data and reduces costs to both the regulated community and ADEM. The Permittee Participation Package may be downloaded online at <https://e2.adem.alabama.gov/npdes> or you may obtain a hard copy by submitting a written request or by emailing e2admin@adem.alabama.gov.

The Alabama Department of Environmental Management encourages you to voluntarily consider pollution prevention practices and alternatives at your facility. Pollution Prevention may assist you in complying with effluent limitations, and possibly reduce or eliminate monitoring requirements.

Should you have any questions, please contact the undersigned by email at storbert@adem.state.al.us or by phone at (334) 271-7800.

Sincerely,

A handwritten signature in black ink, appearing to read "Shanda Torbert".

Shanda Torbert
Municipal Section
Water Division

st/mfc
Enclosure

cc: Mr. Mark Nuhfer/Environmental Protection Agency
Ms. Elaine Snyder/U.S. Fish and Wildlife Service
Ms. Elizabeth Brown/Alabama Historical Commission
Advisory Council on Historic Preservation
Department of Conservation and Natural Resources

Birmingham Branch
110 Vulcan Road
Birmingham, AL 35209-4702
(205) 942-6168
(205) 941-1603 (FAX)

Decatur Branch
2715 Sandlin Road, S. W.
Decatur, AL 35603-1333
(256) 353-1713
(256) 340-9359 (FAX)



Mobile Branch
2204 Perimeter Road
Mobile, AL 36615-1131
(251) 450-3400
(251) 479-2593 (FAX)

Mobile-Coastal
4171 Commanders Drive
Mobile, AL 36615-1421
(251) 432-6533
(251) 432-6598 (FAX)



NATIONAL POLLUTANT DISCHARGE ELIMINATION SYSTEM PERMIT

PERMITTEE: ALABAMA WASTEWATER SYSTEMS, INC.
851 AVIATION PARKWAY
SMYRNA, TENNESSEE 37167

FACILITY LOCATION: PINE FOREST WWTF (2.0) MGD
HWY 80 - LINE CREEK AT THE MACON/MONTGOMERY COUNTY LINE
PIKE ROAD, ALABAMA
MONTGOMERY COUNTY

PERMIT NUMBER: AL0079634

RECEIVING WATERS: LINE CREEK

In accordance with and subject to the provisions of the Federal Water Pollution Control Act, as amended, 33 U.S.C. §§1251-1378 (the "FWPCA"), the Alabama Water Pollution Control Act, as amended, Code of Alabama 1975, §§ 22-22-1 to 22-22-14 (the "AWPCA"), the Alabama Environmental Management Act, as amended, Code of Alabama 1975, §§22-22A-1 to 22-22A-15, and rules and regulations adopted thereunder, and subject further to the terms and conditions set forth in this permit, the Permittee is hereby authorized to discharge into the above-named receiving waters.

ISSUANCE DATE:

EFFECTIVE DATE:

EXPIRATION DATE:

Draft

Alabama Department of Environmental Management

MUNICIPAL SECTION
NATIONAL POLLUTANT DISCHARGE ELIMINATION SYSTEM (NPDES)
PERMIT

TABLE OF CONTENTS

PART I	DISCHARGE LIMITATIONS, CONDITIONS, AND REQUIREMENTS	4
A.	DISCHARGE LIMITATIONS AND MONITORING REQUIREMENTS	4
1.	Outfall 0011 Discharge Limits	4
2.	Outfall 0011 Discharge Limits (continued).....	5
3.	Outfall 001T Discharge Limits - Toxicity	6
B.	DISCHARGE MONITORING AND RECORD KEEPING REQUIREMENTS	7
1.	Representative Sampling	7
2.	Measurement Frequency	7
3.	Test Procedures	7
4.	Recording of Results	8
5.	Records Retention and Production	8
6.	Reduction, Suspension or Termination of Monitoring and/or Reporting	8
7.	Monitoring Equipment and Instrumentation	8
C.	DISCHARGE REPORTING REQUIREMENTS	8
1.	Reporting of Monitoring Requirements	8
2.	Noncompliance Notification	11
D.	OTHER REPORTING AND NOTIFICATION REQUIREMENTS	12
1.	Anticipated Noncompliance	12
2.	Termination of Discharge.....	12
3.	Updating Information	12
4.	Duty to Provide Information	12
E.	SCHEDULE OF COMPLIANCE	12
1.	Compliance with discharge limits	12
2.	Schedule	12
PART II	OTHER REQUIREMENTS, RESPONSIBILITIES, AND DUTIES	13
A.	OPERATIONAL AND MANAGEMENT REQUIREMENTS	13
1.	Facilities Operation and Maintenance	13
2.	Best Management Practices	13
3.	Certified Operator	13
B.	OTHER RESPONSIBILITIES	13
1.	Duty to Mitigate Adverse Impacts	13
2.	Right of Entry and Inspection	13
C.	BYPASS AND UPSET	13
1.	Bypass	13
2.	Upset	14
D.	DUTY TO COMPLY WITH PERMIT, RULES, AND STATUTES	14
1.	Duty to Comply	14
2.	Removed Substances.....	15
3.	Loss or Failure of Treatment Facilities	15
4.	Compliance With Statutes and Rules	15
E.	PERMIT TRANSFER, MODIFICATION, SUSPENSION, REVOCATION, AND REISSUANCE	15
1.	Duty to Reapply or Notify of Intent to Cease Discharge.....	15
2.	Change in Discharge	15
3.	Transfer of Permit	16
4.	Permit Modification and Revocation	16
5.	Termination.....	17
6.	Suspension	17
7.	Stay.....	17
F.	COMPLIANCE WITH TOXIC POLLUTANT STANDARD OR PROHIBITION	17
G.	NOTICE TO DIRECTOR OF INDUSTRIAL USERS	17
H.	PROHIBITIONS.....	18

PART III	ADDITIONAL REQUIREMENTS, CONDITIONS, AND LIMITATIONS.....	19
A.	CIVIL AND CRIMINAL LIABILITY.....	19
1.	Tampering.....	19
2.	False Statements.....	19
3.	Permit Enforcement.....	19
4.	Relief from Liability.....	19
B.	OIL AND HAZARDOUS SUBSTANCE LIABILITY.....	19
C.	PROPERTY AND OTHER RIGHTS.....	20
D.	AVAILABILITY OF REPORTS.....	20
E.	EXPIRATION OF PERMITS FOR NEW OR INCREASED DISCHARGES.....	20
F.	COMPLIANCE WITH WATER QUALITY STANDARDS.....	20
G.	GROUNDWATER.....	21
H.	DEFINITIONS.....	21
I.	SEVERABILITY.....	23
PART IV	SPECIFIC REQUIREMENTS, CONDITIONS, AND LIMITATIONS.....	24
A.	SLUDGE MANAGEMENT PRACTICES.....	24
1.	Applicability.....	24
2.	Submitting Information.....	24
3.	Reopener or Modification.....	24
B.	EFFLUENT TOXICITY LIMITATIONS AND BIOMONITORING REQUIREMENTS FOR CHRONIC TOXICITY.....	24
1.	Chronic Toxicity Test.....	24
2.	General Test Requirements.....	25
3.	Reporting Requirements.....	25
4.	Additional Testing Requirements.....	25
5.	Test Methods.....	25
6.	Effluent Toxicity Testing Reports.....	25
C.	TOTAL RESIDUAL CHLORINE (TRC) REQUIREMENTS.....	27
D.	PLANT CLASSIFICATION.....	27
E.	POLLUTANT SCANS.....	27

ATTACHMENT:
FORM 421

NON-COMPLIANCE NOTIFICATION FORM

PART I**DISCHARGE LIMITATIONS, CONDITIONS, AND REQUIREMENTS****A. DISCHARGE LIMITATIONS AND MONITORING REQUIREMENTS****1. Outfall 0011 Discharge Limits**

During the period beginning on the effective date of this permit and lasting through the expiration date of this permit, the Permittee is authorized to discharge from Outfall 0011, which is described more fully in the Permittee's application. Such discharge shall be limited and monitored by the Permittee as specified below:

<u>Parameter</u>	<u>Discharge Limitations*</u>							<u>Monitoring Requirements**</u>			
	<u>Monthly Average</u>	<u>Weekly Average</u>	<u>Monthly Average</u>	<u>Weekly Average</u>	<u>Daily Minimum</u>	<u>Daily Maximum</u>	<u>Percent Removal</u>	<u>(1) Sample Location</u>	<u>(2) Sample Type</u>	<u>(3) Measurement Frequency</u>	<u>(4) Seasonal</u>
Oxygen, Dissolved (DO) 00300 1 0 0	*****	*****	*****	*****	6.0 mg/l	*****	*****	E	GRAB	D	*****
pH 00400 1 0 0	*****	*****	*****	*****	6.0 S.U.	8.5 S.U.	*****	E	GRAB	D	*****
Solids, Total Suspended 00530 1 0 0	400 lbs/day	600 lbs/day	24.0 mg/l	36.0 mg/l	*****	*****	*****	E	COMP24	D	*****
Solids, Total Suspended 00530 G 0 0	REPORT lbs/day	REPORT lbs/day	REPORT mg/l	REPORT mg/l	*****	*****	*****	I	COMP24	D	*****
Nitrogen, Ammonia Total (As N) 00610 1 0 0	16.6 lbs/day	25.0 lbs/day	1.0 mg/l	1.5 mg/l	*****	*****	*****	E	COMP24	D	S
Nitrogen, Ammonia Total (As N) 00610 I 0 0	50.0 lbs/day	75.0 lbs/day	3.0 mg/l	4.5 mg/l	*****	*****	*****	E	COMP24	D	W
Nitrogen, Kjeldahl Total (As N) 00625 1 0 0	REPORT lbs/day	REPORT lbs/day	REPORT mg/l	REPORT mg/l	*****	*****	*****	E	COMP24	G See Note 5	*****
Nitrite Plus Nitrate Total (As N) 00630 1 0 0	REPORT lbs/day	REPORT lbs/day	REPORT mg/l	REPORT mg/l	*****	*****	*****	E	COMP24	G See Note 5	*****
Phosphorus, Total (As P) 00665 1 0 0	REPORT lbs/day	REPORT lbs/day	REPORT mg/l	REPORT mg/l	*****	*****	*****	E	COMP24	G See Note 5	*****
Flow, In Conduit or Thru Treatment Plant 50050 1 0 0	REPORT MGD	*****	*****	*****	*****	REPORT MGD	*****	E	CONTIN	A	*****

* See Part II.C.1. (Bypass); Part II.C.2. (Upset)

** Monitoring Requirements

(1) Sample Location

I – Influent

E – Effluent

X – End Chlorine Contact Chamber

K – Percent Removal of the Monthly Avg. Influent Concentration from the Monthly Avg. Effluent Concentration.

RS – Receiving Stream

(2) Sample Type:

CONTIN - Continuous

INSTAN - Instantaneous

COMP-8 - 8-Hour Composite

COMP24 - 24-Hour Composite

GRAB – Grab

CALCTD - Calculated

(3) Measurement Frequency: See also Part I.B.2.

A - 7 days per week

B - 5 days per week

C - 3 days per week

D - 2 days per week

E - 1 day per week

F - 2 days per month

G - 1 day per month

H - 1 day per quarter

J - Annual

Q - For Effluent Toxicity

Testing, see Provision IV.B.

(4) Seasonal Limits:

S = Summer (April – October)

W = Winter (November – March)

ECS = *E. coli* Summer (June – September)

ECW = *E. coli* Winter (October – May)

(5) If only one sampling event occurs during a month, the sample result shall be reported on the DMR as both the monthly average and weekly average.

Limits for Outfall 0011 continued on the next page.

2. Outfall 0011 Discharge Limits (continued)

During the period beginning on the effective date of this permit and lasting through the expiration date of this permit, the Permittee is authorized to discharge from Outfall 0011, which is described more fully in the Permittee's application. Such discharge shall be limited and monitored by the Permittee as specified below:

<u>Parameter</u>	<u>Discharge Limitations*</u>							<u>Monitoring Requirements**</u>			
	<u>Monthly Average</u>	<u>Weekly Average</u>	<u>Monthly Average</u>	<u>Weekly Average</u>	<u>Daily Minimum</u>	<u>Daily Maximum</u>	<u>Percent Removal</u>	<u>(1) Sample Location</u>	<u>(2) Sample Type</u>	<u>(3) Measurement Frequency</u>	<u>(4) Seasonal</u>
Chlorine, Total Residual 50060 1 0 0	*****	*****	0.012 mg/l	*****	*****	0.021 mg/l	*****	E	GRAB	D See Note 5	*****
E. Coli 51040 1 0 0	*****	*****	126 col/100mL	*****	*****	487 col/100mL	*****	E	GRAB	D	ECS
E. Coli 51040 1 0 0	*****	*****	548 col/100mL	*****	*****	2507 col/100mL	*****	E	GRAB	D	ECW
BOD, Carbonaceous 05 Day, 20C 80082 1 0 0	66.7 lbs/day	100 lbs/day	4.0 mg/l	6.0 mg/l	*****	*****	*****	E	COMP24	D	S
BOD, Carbonaceous 05 Day, 20C 80082 1 0 0	200 lbs/day	300 lbs/day	12.0 mg/l	18.0 mg/l	*****	*****	*****	E	COMP24	D	W
BOD, Carbonaceous 05 Day, 20C 80082 G 0 0	REPORT lbs/day	REPORT lbs/day	REPORT mg/l	REPORT mg/l	*****	*****	*****	I	COMP24	D	*****

* See Part II.C.1. (Bypass); Part II.C.2. (Upset)

** Monitoring Requirements

(1) Sample Location

I – Influent

E – Effluent

X – End Chlorine Contact Chamber

K – Percent Removal of the Monthly Avg. Influent Concentration from the Monthly Avg. Effluent Concentration.

RS – Receiving Stream

(2) Sample Type:

CONTIN - Continuous

INSTAN - Instantaneous

COMP-8 - 8-Hour Composite

COMP24 - 24-Hour Composite

GRAB – Grab

CALCTD - Calculated

(3) Measurement Frequency: See also Part I.B.2.

A - 7 days per week

B - 5 days per week

C - 3 days per week

D - 2 days per week

E - 1 day per week

F - 2 days per month

G - 1 day per month

H - 1 day per quarter

J - Annual

Q - For Effluent Toxicity

Testing, see Provision IV.B.

(4) Seasonal Limits:

S = Summer (April – October)

W = Winter (November – March)

ECS = E. coli Summer (June – September)

ECW = E. coli Winter (October – May)

(5) See Part IV.C. for Total Residual Chlorine (TRC). Monitoring for TRC is applicable if chlorine is utilized for disinfection purposes. If monitoring is not applicable during the monitoring period, enter "NODI=9" on the monthly DMR.

3. Outfall 001T Discharge Limits - Toxicity

Outfall 001T represents the same physical outfall as Outfall 0011. The Department uses the 001T designation for all samples collected and analyzed for Toxicity testing, which is described more fully in the Permittee's application. Such discharge shall be limited and monitored by the Permittee as specified below:

<u>Parameter</u>	<u>Discharge Limitations*</u>							<u>Monitoring Requirements**</u>			
	<u>Monthly Average</u>	<u>Weekly Average</u>	<u>Monthly Average</u>	<u>Weekly Average</u>	<u>Daily Minimum</u>	<u>Daily Maximum</u>	<u>Percent Removal</u>	<u>(1) Sample Location</u>	<u>(2) Sample Type</u>	<u>(3) Measurement Frequency</u>	<u>(4) Seasonal</u>
Toxicity, Ceriodaphnia Chronic 61426 1 0 0	*****	Pass = 0 Fail = 1	*****	*****	*****	*****	*****	E	COMP24	Q	*****
Toxicity, Pimephales Chronic 61428 1 0 0	*****	Pass = 0 Fail = 1	*****	*****	*****	*****	*****	E	COMP24	Q	*****

* See Part II.C.1. (Bypass); Part II.C.2. (Upset)

** Monitoring Requirements

(1) Sample Location

I - Influent

E - Effluent

X - End Chlorine Contact Chamber

K - Percent Removal of the Monthly Avg. Influent Concentration from the Monthly Avg. Effluent Concentration.

RS - Receiving Stream

(2) Sample Type:

CONTIN - Continuous

INSTAN - Instantaneous

COMP-8 - 8-Hour Composite

COMP24 - 24-Hour Composite

GRAB - Grab

CALCTD - Calculated

(3) Measurement Frequency: See also Part I.B.2.

A - 7 days per week

B - 5 days per week

C - 3 days per week

D - 2 days per week

E - 1 day per week

F - 2 days per month

G - 1 day per month

H - 1 day per quarter

J - Annual

Q - For Effluent Toxicity

Testing, see Provision IV.B.

(4) Seasonal Limits:

S = Summer (April - October)

W = Winter (November - March)

ECS = E. coli Summer (June - September)

ECW = E. coli Winter (October - May)

B. DISCHARGE MONITORING AND RECORD KEEPING REQUIREMENTS

1. Representative Sampling

Sample collection and measurement actions shall be representative of the volume and nature of the monitored discharge and shall be in accordance with the provisions of this permit. The effluent sampling point shall be at the nearest accessible location just prior to discharge and after final treatment, unless otherwise specified in the permit.

2. Measurement Frequency

Measurement frequency requirements found in Provision I.A. shall mean:

- a. Seven days per week shall mean daily.
- b. Five days per week shall mean any five days of discharge during a calendar weekly period of Sunday through Saturday.
- c. Three days per week shall mean any three days of discharge during a calendar week.
- d. Two days per week shall mean any two days of discharge during a calendar week.
- e. One day per week shall mean any day of discharge during a calendar week.
- f. Two days per month shall mean any two days of discharge during the month that are no less than seven days apart. However, if discharges occur only during one seven-day period in a month, then two days per month shall mean any two days of discharge during that seven day period.
- g. One day per month shall mean any day of discharge during the calendar month.
- h. Quarterly shall mean any day of discharge during each calendar quarter.
- i. The Permittee may increase the frequency of sampling, listed in Provisions I.B.2.a through I.B.2.h; however, all sampling results are to be reported to the Department.

3. Test Procedures

For the purpose of reporting and compliance, Permittees shall use one of the following procedures:

- a. For parameters with an EPA established Minimum Level (ML), report the measured value if the analytical result is at or above the ML and report "0" for values below the ML. Test procedures for the analysis of pollutants shall conform to 40 CFR Part 136 and guidelines published pursuant to Section 304(h) of the FWPCA, 33 U.S.C. Section 1314(h). If more than one method for analysis of a substance is approved for use, a method having a minimum level lower than the permit limit shall be used. If the minimum level of all methods is higher than the permit limit, the method having the lowest minimum level shall be used and a report of less than the minimum level shall be reported as zero and will constitute compliance, however should EPA approve a method with a lower minimum level during the term of this permit the Permittee shall use the newly approved method.
- b. For pollutants parameters without an established ML, an interim ML may be utilized. The interim ML shall be calculated as 3.18 times the Method Detection Level (MDL) calculated pursuant to 40 CFR Part 136, Appendix B.

Permittees may develop an effluent matrix-specific ML, where an effluent matrix prevents attainment of the established ML. However, a matrix specific ML shall be based upon proper laboratory method and technique. Matrix-specific MLs must be approved by the Department, and may be developed by the Permittee during permit issuance, reissuance, modification, or during compliance schedule.

In either case the measured value should be reported if the analytical result is at or above the ML and "0" reported for values below the ML.

- c. For parameters without an EPA established ML, interim ML, or matrix-specific ML, a report of less than the detection limit shall constitute compliance if the detection limit of all analytical methods is higher than the permit limit. For the purpose of calculating a monthly average, "0" shall be used for values reported less than the detection limit.

The Minimum Level utilized for procedures a and b above shall be reported on the Permittee's DMR. When an EPA approved test procedure for analysis of a pollutant does not exist, the Director shall approve the procedure to be used.

4. Recording of Results

For each measurement or sample taken pursuant to the requirements of this permit, the Permittee shall record the following information:

- a. The facility name and location, point source number, date, time and exact place of sampling;
- b. The name(s) of person(s) who obtained the samples or measurements;
- c. The dates and times the analyses were performed;
- d. The name(s) of the person(s) who performed the analyses;
- e. The analytical techniques or methods used, including source of method and method number; and
- f. The results of all required analyses.

5. Records Retention and Production

- a. The permittee shall retain records of all monitoring information, including all calibration and maintenance records and all original strip chart recordings for continuous monitoring instrumentation, copies of all reports required by the permit, and records of all data used to complete the above reports or the application for this permit, for a period of at least three years from the date of the sample measurement, report or application. This period may be extended by request of the Director at any time. If litigation or other enforcement action, under the AWPCA and/or the FWPCA, is ongoing which involves any of the above records, the records shall be kept until the litigation is resolved. Upon the written request of the Director or his designee, the permittee shall provide the Director with a copy of any record required to be retained by this paragraph. Copies of these records should not be submitted unless requested.
- b. All records required to be kept for a period of three years shall be kept at the permitted facility or an alternate location approved by the Department in writing and shall be available for inspection.

6. Reduction, Suspension or Termination of Monitoring and/or Reporting

- a. The Director may, with respect to any point source identified in Provision I.A. of this permit, authorize the permittee to reduce, suspend or terminate the monitoring and/or reporting required by this permit upon the submission of a written request for such reduction, suspension or termination by the permittee, supported by sufficient data which demonstrates to the satisfaction of the Director that the discharge from such point source will continuously meet the discharge limitations specified in Provision I.A. of this permit.
- b. It remains the responsibility of the permittee to comply with the monitoring and reporting requirements of this permit until written authorization to reduce, suspend or terminate such monitoring and/or reporting is received by the permittee from the Director.

7. Monitoring Equipment and Instrumentation

All equipment and instrumentation used to determine compliance with the requirements of this permit shall be installed, maintained, and calibrated in accordance with the manufacturer's instructions or, in the absence of manufacturer's instructions, in accordance with accepted practices. At a minimum, flow measurement devices shall be calibrated at least once every 12 months.

C. DISCHARGE REPORTING REQUIREMENTS

1. Reporting of Monitoring Requirements

- a. The permittee shall conduct the required monitoring in accordance with the following schedule:

- (1) **MONITORING REQUIRED MORE FREQUENTLY THAN MONTHLY AND MONTHLY** shall be conducted during the first full month following the effective date of coverage under this permit and every month thereafter.

- (2) **QUARTERLY MONITORING** shall be conducted at least once during each calendar quarter. Calendar quarters are the periods of January through March, April through June, July through September, and October through December. The Permittee shall conduct the quarterly monitoring during the first complete calendar quarter following the effective date of this permit and is then required to monitor once during each quarter thereafter. Quarterly monitoring should be reported on the last DMR due for the quarter (i.e. March, June, September and December DMRs).
 - (3) **SEMIANNUAL MONITORING** shall be conducted at least once during the period of January through June and at least once during the period of July through December. The Permittee shall conduct the semiannual monitoring during the first complete calendar semiannual period following the effective date of this permit and is then required to monitor once during each semiannual period thereafter. Semiannual monitoring may be done anytime during the semiannual period, unless restricted elsewhere in this permit, but it should be reported on the last DMR due for the month of the semiannual period (i.e. June and December DMRs).
 - (4) **ANNUAL MONITORING** shall be conducted at least once during the period of January through December. The Permittee shall conduct the annual monitoring during the first complete calendar annual period following the effective date of this permit and is then required to monitor once during each annual period thereafter. Annual monitoring may be done anytime during the year, unless restricted elsewhere in this permit, but it should be reported on the December DMR.
- b. The permittee shall submit discharge monitoring reports (DMRs) on the forms approved by the Department and in accordance with the following schedule:
- (1) **REPORTS OF MORE FREQUENTLY THAN MONTHLY AND MONTHLY TESTING** shall be submitted on a monthly basis. The first report is due on the 28th day of the month following the month the permit becomes effective. The reports shall be submitted so that they are received by the Department no later than the 28th day of the month following the reporting period.
 - (2) **REPORTS OF QUARTERLY TESTING** shall be submitted on a quarterly basis. The first report is due on the 28th day of the month following the month the permit becomes effective. The reports shall be submitted so that they are received by the Department no later than the 28th day of the month following the reporting period.
 - (3) **REPORTS OF SEMIANNUAL TESTING** shall be submitted on a semiannual basis. The reports are due on the 28th day of JANUARY and the 28th day of JULY. The reports shall be submitted so that they are received by the Department no later than the 28th day of the month following the reporting period.
 - (4) **REPORTS OF ANNUAL TESTING** shall be submitted on an annual basis. Unless specified elsewhere in the permit, the first report is due on the 28th day of JANUARY. The reports shall be submitted so that they are received by the Department no later than the 28th day of the month following the reporting period.
- c. The Department is utilizing a web-based electronic environmental (E2) reporting system for submittal of DMRs. The E2 DMR system allows ADEM to electronically validate, acknowledge receipt, and upload data to the state's central wastewater database. This improves the accuracy of reported compliance data and reduces costs to both the regulated community and ADEM. If the Permittee is not already participating in the E2 DMR system, **the Permittee must apply for participation in the E2 DMR system within 180 days of the effective date of this permit unless valid justification as to why they cannot participate is submitted in writing. After 180 days, hard copy DMRs may be used only with written approval from the Department.** To participate in the E2 DMR system, the Permittee Participation Package may be downloaded online at <https://e2.adem.alabama.gov/npdes>. If the electronic environmental (E2) reporting system is down (i.e. electronic submittal of DMR data is unable to be completed due to technical problems originating with the Department's system; this could include entry/submittal issues with an entire set of DMRs or individual parameters), permittees are not relieved of their obligation to submit DMR data to the Department by the required submittal date. However, if the E2 system is down on the 28th day of the month or is down for an extended period of time as determined by the Department when a DMR is required to be submitted, the facility

may submit the data in an alternate manner and format acceptable to the Department. Preapproved alternate acceptable methods include faxing, e-mailing, mailing, or hand-delivery of data such that they are received by the required reporting date. Within five calendar days of the E2 system resuming operation, the permittee shall enter the data into the E2 reporting system unless an alternate timeframe is approved by the Department. An attachment should be included with the E2 DMR submittal verifying the original submittal date (date of the fax, copy of dated e-mail, or hand-delivery stamped date). If a permittee is allowed to submit via the US Postal Service, the DMR must be legible and bear an original signature. Photo and electronic copies of the signature are not acceptable and shall not satisfy the reporting requirements of this permit. If the Permittee, using approved analytical methods as specified in Provision I. B. 2. monitors any discharge from a point source for a substance identified in Provision I. A. of this permit more frequently than required by this permit, the results of such monitoring shall be included in the calculation and reporting of values on the DMR Form and the increased frequency shall be indicated on the DMR Form. In the event no discharge from a point source identified in Provision I. A. of this permit and described more fully in the Permittee's application occurs during a monitoring period, the Permittee shall report "No Discharge" for such period on the appropriate DMR Form.

- d. All reports and forms required to be submitted by this permit, the AWPCA and the Department's Rules and regulations, shall be electronically signed (or, if allowed by the Department, traditionally signed) by a "responsible official" of the permittee as defined in ADEM Administrative Code Rule 335-6-6-.09 or a "duly authorized representative" of such official as defined in ADEM Administrative Code Rule 335-6-6-.09 and shall bear the following certification:

"I certify under penalty of law that this document and all attachments were prepared under my direction or supervision in accordance with a system designed to assure that qualified personnel properly gather and evaluate the information submitted. Based on my inquiry of the person or persons who manage the system, or those persons directly responsible for gathering information, the information submitted is, to the best of my knowledge and belief, true, accurate, and complete. I am aware that there are significant penalties for submitting false information, including the possibility of fine and imprisonment for knowing violations."

- e. The permittee may certify in writing that a discharge will not occur for an extended period of time and after such certification shall not be required to submit monitoring reports. Written notification of a planned resumption of discharge shall be submitted at least 30 days prior to resumption of the discharge. If an unplanned resumption of discharge occurs, written notification shall be submitted within 7 days of the resumption. In any case, all discharges shall comply with all provisions of this permit.
- f. All reports and forms required to be submitted by this permit, the AWPCA and the Department's Rules, shall be addressed to:

**Alabama Department of Environmental Management
Municipal Section, Water Division
Post Office Box 301463
Montgomery, Alabama 36130-1463**

Certified and Registered Mail shall be addressed to:

**Alabama Department of Environmental Management
Municipal Section, Water Division
1400 Coliseum Boulevard
Montgomery, Alabama 36110-2059**

DMRs required to be submitted by this permit shall be addressed to:

**Alabama Department of Environmental Management
Environmental Data Section, Permits & Services Division
Post Office Box 301463
Montgomery, Alabama 36130-1463**

- g. If this permit is a re-issuance, then the Permittee shall continue to submit DMRs in accordance with the requirements of their previous permit until such time as DMRs are due as discussed in Part I.C.1.b. above.

2. Noncompliance Notification

- a. The Permittee must notify the Department if, for any reason, the Permittee's discharge:
- (1) Does not comply with any daily minimum or maximum discharge limitation for an effluent characteristic specified in Provision I. A. of this permit which is denoted by an "(X)"
 - (2) Potentially threatens human health or welfare,
 - (3) Threatens fish or aquatic life
 - (4) Causes an in-stream water quality criterion to be exceeded;
 - (5) Does not comply with an applicable toxic pollutant effluent standard or prohibition established under Section 307(a) of the FWPCA, 33 U.S.C. Section 1317(a);
 - (6) Contains a quantity of a hazardous substance that may be harmful to public health or welfare under Section 311(b)(4) of the FWPCA, 33 U.S.C. Section 1321(b)(4);
 - (7) Exceeds any discharge limitation for an effluent parameter listed in Part I.A as a result of an unanticipated bypass or upset; or
 - (8) Is an unpermitted direct or indirect discharge of a pollutant to a water of the state (Note that unpermitted discharges properly reported to the Department under any other requirement are not required to be reported under this provision)

The Permittee shall orally or electronically report any of the above occurrences, describing the circumstances and potential effects, to the Department within 24-hours after the Permittee becomes aware of the occurrence of such discharge. In addition to the oral or electronic report, the Permittee shall submit a written report to the Director or Designee, as provided in Provision I.C.2.c, no later than five days after becoming aware of the occurrence of such discharge or occurrence.

- b. If for any reason, the Permittee's discharge does not comply with any limitation of this permit, then the Permittee must submit a written report to the Director or Designee, as provided in Provision I.C.2.c below. This report must be submitted with the next Discharge Monitoring Report required to be submitted by Provision I.C.1 of this permit after becoming aware of the occurrence of such noncompliance.
- c. Form 421 must be submitted to the Director or Designee in accordance with Provisions I.C.2a. or b. The completed form must document the following information:
- (1) A description of the discharge and cause of noncompliance;
 - (2) The period of noncompliance, including exact dates, times, and duration of the noncompliance. If not corrected by the due date of the written report, then the Permittee is to state the anticipated timeframe that is expected to transpire before the noncompliance is resolved; and
 - (3) A description of the steps taken by the Permittee and the steps planned to be taken by the Permittee to reduce or eliminate the noncompliant discharge, including all steps taken to prevent recurrence.
- d. Immediate notification
- The Permittee shall provide notification to the Director, the public, the county health department, and any other affected entity such as public water systems, as soon as possible upon becoming aware of any notifiable sanitary sewer overflow. The Permittee shall also report notification of the noncompliance event to any other affected entity such as the public.
- e. The Permittee shall report SSO and other illicit or anomalous discharge events on Form 415 in accordance with Part I.C.2.a. This form is available on the ADEM web page or upon request from the Permittee.

D. OTHER REPORTING AND NOTIFICATION REQUIREMENTS

1. Anticipated Noncompliance

The Permittee shall give the Director written advance notice of any planned changes or other circumstances regarding a facility which may result in noncompliance with permit requirements.

2. Termination of Discharge

The Permittee shall notify the Director, in writing, when all discharges from any point source(s) identified in Provision I. A. of this permit have permanently ceased. This notification shall serve as sufficient cause for instituting procedures for modification or termination of the permit.

3. Updating Information

- a. The permittee shall inform the Director of any change in the permittee's mailing address or telephone number or in the permittee's designation of a facility contact or office having the authority and responsibility to prevent and abate violations of the AWPCA, the Department's Rules and the terms and conditions of this permit, in writing, no later than ten (10) days after such change. Upon request of the Director or his designee, the permittee shall furnish the Director with an update of any information provided in the permit application.
- b. If the permittee becomes aware that it failed to submit any relevant facts in a permit application, or submitted incorrect information in a permit application or in any report to the Director, it shall promptly submit such facts or information with a written explanation for the mistake and/or omission.

4. Duty to Provide Information

The Permittee shall furnish to the Director, within a reasonable time, any information which the Director or his designee may request to determine whether cause exists for modifying, revoking and re-issuing, suspending, or terminating this permit, in whole or in part, or to determine compliance with this permit.

E. SCHEDULE OF COMPLIANCE

1. Compliance with discharge limits

The Permittee shall achieve compliance with the discharge limitations specified in Provision I. A. in accordance with the following schedule:

COMPLIANCE SHALL BE ATTAINED ON THE EFFECTIVE DATE OF THIS PERMIT

2. Schedule

- a. Within 730 days from the first effluent discharge to Line Creek, the Permittee shall submit to the Department two completed copies of EPA Form 2A Part D "Supplemental Application Information: Expanded Effluent Testing Data." Samples must be representative of the seasonal variation in the discharge from Outfall 0011.
- b. No later than 14 calendar days following a date identified in the above schedule of compliance, the Permittee shall submit either a report of progress or, in the case of specific actions being required by identified dates, a written notice of compliance or noncompliance. In the latter case, the notice shall include the cause of noncompliance, any remedial actions taken, and the probability of meeting the next scheduled requirement.

PART II OTHER REQUIREMENTS, RESPONSIBILITIES, AND DUTIES

A. OPERATIONAL AND MANAGEMENT REQUIREMENTS

1. Facilities Operation and Maintenance

The Permittee shall at all times properly operate and maintain all facilities and systems of treatment and control (and related appurtenances) which are installed or used by the Permittee to achieve compliance with the conditions of the permit. Proper operation and maintenance includes effective performance, adequate funding, adequate operator staffing and training, and adequate laboratory and process controls, including appropriate quality assurance procedures. This provision requires the operation of backup or auxiliary facilities only when necessary to achieve compliance with the conditions of the permit.

2. Best Management Practices

- a. Dilution water shall not be added to achieve compliance with discharge limitations except when the Director or his designee has granted prior written authorization for dilution to meet water quality requirements.
- b. The permittee shall prepare, implement, and maintain a Spill Prevention, Control and Countermeasures (SPCC) Plan in accordance with 40 C.F.R. Section 112 if required thereby.
- c. The permittee shall prepare, submit for approval and implement a Best Management Practices (BMP) Plan for containment of any or all process liquids or solids, in a manner such that these materials do not present a significant potential for discharge, if so required by the Director or his designee. When submitted and approved, the BMP Plan shall become a part of this permit and all requirements of the BMP Plan shall become requirements of this permit.

3. Certified Operator

The Permittee shall not operate any wastewater treatment plant unless the competency of the operator to operate such plant has been duly certified by the Director pursuant to AWPCA, and meets the requirements specified in ADEM Administrative Code, Rule 335-10-1.

B. OTHER RESPONSIBILITIES

1. Duty to Mitigate Adverse Impacts

The permittee shall promptly take all reasonable steps to mitigate and minimize or prevent any adverse impact on human health or the environment resulting from noncompliance with any discharge limitation specified in Provision I. A. of this permit, including such accelerated or additional monitoring of the discharge and/or the receiving waterbody as necessary to determine the nature and impact of the noncomplying discharge.

2. Right of Entry and Inspection

- a. The permittee shall allow the Director, or an authorized representative, upon the presentation of proper credentials and other documents as may be required by law to:
 - (1) Enter upon the permittee's premises where a regulated facility or activity or point source is located or conducted, or where records must be kept under the conditions of the permit;
 - (2) Have access to and copy, at reasonable times, any records that must be kept under the conditions of the permits.
 - (3) Inspect any facilities, equipment (including monitoring and control equipment), practices, or operations regulated or required under the permit; and
 - (4) Sample or monitor, for the purposes of assuring permit compliance or as otherwise authorized by the AWPCA, any substances or parameters at any location.

C. BYPASS AND UPSET

1. Bypass

- a. Any bypass is prohibited except as provided in b. and c. below:

- b. A bypass is not prohibited if:
 - (1) It does not cause any discharge limitation specified in Provision I. A. of this permit to be exceeded;
 - (2) It enters the same receiving stream as the permitted outfall and;
 - (3) It is necessary for essential maintenance of a treatment or control facility or system to assure efficient operation of such facility or system.
 - c. A bypass is not prohibited and need not meet the discharge limitations specified in Provision I. A. of this permit if:
 - (1) It is unavoidable to prevent loss of life, personal injury, or severe property damage;
 - (2) There are no feasible alternatives to the bypass, such as the use of auxiliary treatment facilities, retention of untreated wastes, or maintenance during normal periods of equipment downtime (this condition is not satisfied if adequate back-up equipment should have been installed in the exercise of reasonable engineering judgment to prevent a bypass which occurred during normal periods of equipment downtime or preventive maintenance); and
 - (3) The Permittee submits a written request for authorization to bypass to the Director at least ten (10) days prior to the anticipated bypass (if possible), the Permittee is granted such authorization, and the Permittee complies with any conditions imposed by the Director to minimize any adverse impact on human health or the environment resulting from the bypass.
 - d. The permittee has the burden of establishing that each of the conditions of Provision II. C. 1. b. or c. have been met to qualify for an exception to the general prohibition against bypassing contained in a. and an exemption, where applicable, from the discharge limitations specified in Provision I. A. of this permit.
2. Upset
- a. A discharge which results from an upset need not meet the discharge limitations specified in Provision I. A. of this permit if:
 - (1) No later than 24-hours after becoming aware of the occurrence of the upset, the Permittee orally reports the occurrence and circumstances of the upset to the Director or his designee; and
 - (2) No later than five (5) days after becoming aware of the occurrence of the upset, the Permittee furnishes the Director with evidence, including properly signed, contemporaneous operating logs, or other relevant evidence, demonstrating that:
 - (i) An upset occurred;
 - (ii) The Permittee can identify the specific cause(s) of the upset;
 - (iii) The Permittee's facility was being properly operated at the time of the upset; and
 - (iv) The Permittee promptly took all reasonable steps to minimize any adverse impact on human health or the environment resulting from the upset.
 - b. The permittee has the burden of establishing that each of the conditions of Provision II C. 2. a. of this permit have been met to qualify for an exemption from the discharge limitations specified in Provision I. A. of this permit.

D. DUTY TO COMPLY WITH PERMIT, RULES, AND STATUTES

- 1. Duty to Comply
 - a. The permittee must comply with all conditions of this permit. Any permit noncompliance constitutes a violation of the AWPCA and the FWPCA and is grounds for enforcement action, for permit termination, revocation and reissuance, suspension, modification, or denial of a permit renewal application.
 - b. The necessity to halt or reduce production or other activities in order to maintain compliance with the conditions of the permit shall not be a defense for a permittee in an enforcement action.

- c. The discharge of a pollutant from a source not specifically identified in the permit application for this permit and not specifically included in the description of an outfall in this permit is not authorized and shall constitute noncompliance with this permit.
 - d. The permittee shall take all reasonable steps, including cessation of production or other activities, to minimize or prevent any violation of this permit or to minimize or prevent any adverse impact of any permit violation.
 - e. Nothing in this permit shall be construed to preclude or negate the Permittee's responsibility to apply for, obtain, or comply with other Federal, State, or Local Government permits, certifications, or licenses or to preclude from obtaining other federal, state, or local approvals, including those applicable to other ADEM programs and regulations.
2. **Removed Substances**

Solids, sludges, filter backwash, or any other pollutant or other waste removed in the course of treatment or control of wastewaters shall be disposed of in a manner that complies with all applicable Department Rules.
 3. **Loss or Failure of Treatment Facilities**

Upon the loss or failure of any treatment facilities, including but not limited to the loss or failure of the primary source of power of the treatment facility, the Permittee shall, where necessary to maintain compliance with the discharge limitations specified in Provision I. A. of this permit, or any other terms or conditions of this permit, cease, reduce, or otherwise control production and/or all discharges until treatment is restored. If control of discharge during loss or failure of the primary source of power is to be accomplished by means of alternate power sources, standby generators, or retention of inadequately treated effluent, the Permittee must furnish to the Director within six months a certification that such control mechanisms have been installed.
 4. **Compliance With Statutes and Rules**
 - a. This permit has been issued under ADEM Administrative Code, Chapter 335-6-6. All provisions of this chapter, that are applicable to this permit, are hereby made a part of this permit. A copy of this chapter may be obtained for a small charge from the Office of General Counsel, Alabama Department of Environmental Management, 1400 Coliseum Boulevard Montgomery, Alabama 36110-2059.
 - b. This permit does not authorize the noncompliance with or violation of any Laws of the State of Alabama or the United States of America or any regulations or rules implementing such laws. FWPCA, 33 U.S.C. Section 1319, and Code of Alabama 1975, Section 22-22-14.

E. PERMIT TRANSFER, MODIFICATION, SUSPENSION, REVOCATION, AND REISSUANCE

1. **Duty to Reapply or Notify of Intent to Cease Discharge**
 - a. If the permittee intends to continue to discharge beyond the expiration date of this permit, the permittee shall file a complete permit application for reissuance of this permit at least 180 days prior to its expiration. If the permittee does not intend to continue discharge beyond the expiration of this permit, the permittee shall submit written notification of this intent which shall be signed by an individual meeting the signatory requirements for a permit application as set forth in ADEM Administrative Code Rule 335-6-6-.09.
 - b. Failure of the permittee to apply for reissuance at least 180 days prior to permit expiration will void the automatic continuation of the expiring permit provided by ADEM Administrative Code Rule 335-6-6-.06 and should the permit not be reissued for any reason any discharge after expiration of this permit will be an unpermitted discharge.
2. **Change in Discharge**

Prior to any facility expansion, process modification or any significant change in the method of operation of the permittee's treatment works, the Permittee shall provide the Director with information concerning the planned expansion, modification or change. The Permittee shall apply for a permit modification at least 180 days prior to any facility expansion, process modification, any significant change in the method of operation of the permittee's treatment works or other actions that could result in the discharge of

additional pollutants or increase the quantity of a discharged pollutant or could result in an additional discharge point. This condition applies to pollutants that are or that are not subject to discharge limitations in this permit. No new or increased discharge may begin until the Director has authorized it by issuance of a permit modification or a reissued permit.

3. Transfer of Permit

This permit may not be transferred or the name of the Permittee changed without notice to the Director and subsequent modification or revocation and reissuance of the permit to identify the new Permittee and to incorporate any other changes as may be required under the FWPCA or AWPCA. In the case of a change in name, ownership or control of the permittee's premises only, a request for permit modification in a format acceptable to the Director is required at least 30 days prior to the change. In the case of a change in name, ownership or control of the permittee's premises accompanied by a change or proposed change in effluent characteristics, a complete permit application is required to be submitted to the Director at least 180 days prior to the change. Whenever the Director is notified of a change in name, ownership or control, he may decide not to modify the existing permit and require the submission of a new permit application.

4. Permit Modification and Revocation

a. This permit may be modified or revoked and reissued, in whole or in part, during its term for cause, including but not limited to, the following:

- (1) If cause for termination under Provision II. E. 5. of this permit exists, the Director may choose to revoke and reissue this permit instead of terminating the permit;
- (2) If a request to transfer this permit has been received, the Director may decide to revoke and reissue or to modify the permit; or
- (3) If modification or revocation and reissuance is requested by the permittee and cause exists, the Director may grant the request.

b. This permit may be modified during its term for cause, including but not limited to, the following:

- (1) If cause for termination under Provision II. E. 5. of this permit exists, the Director may choose to modify this permit instead of terminating this permit;
- (2) There are material and substantial alterations or additions to the facility or activity generating wastewater which occurred after permit issuance which justify the application of permit conditions that are different or absent in the existing permit;
- (3) The Director has received new information that was not available at the time of permit issuance and that would have justified the application of different permit conditions at the time of issuance;
- (4) A new or revised requirement(s) of any applicable standard or limitation is promulgated under Sections 301(b)(2)(C), (D), (E), and (F), and 307(a)(2) of the FWPCA;
- (5) Errors in calculation of discharge limitations or typographical or clerical errors were made;
- (6) To the extent allowed by ADEM Administrative Code, Rule 335-6-6-.17, when the standards or regulations on which the permit was based have been changed by promulgation of amended standards or regulations or by judicial decision after the permit was issued;
- (7) To the extent allowed by ADEM Administrative Code, Rule 335-6-6-.17, permits may be modified to change compliance schedules;
- (8) To agree with a granted variance under 301(c), 301(g), 301(h), 301(k), or 316(a) of the FWPCA or for fundamentally different factors;
- (9) To incorporate an applicable 307(a) FWPCA toxic effluent standard or prohibition;
- (10) When required by the reopener conditions in this permit;
- (11) When required under 40 CFR 403.8(e) (compliance schedule for development of pretreatment program);

- (12) Upon failure of the state to notify, as required by Section 402(b)(3) of the FWPCA, another state whose waters may be affected by a discharge permitted by this permit;
- (13) When required to correct technical mistakes, such as errors in calculation, or mistaken interpretations of law made in determining permit conditions; or
- (14) When requested by the Permittee and the Director determines that the modification has cause and will not result in a violation of federal or state law, regulations or rules; or

5. Termination

This permit may be terminated during its term for cause, including but not limited to, the following:

- a. Violation of any term or condition of this permit;
- b. The permittee's misrepresentation or failure to disclose fully all relevant facts in the permit application or during the permit issuance process or the permittee's misrepresentation of any relevant facts at any time;
- c. Materially false or inaccurate statements or information in the permit application or the permit;
- d. A change in any condition that requires either a temporary or permanent reduction or elimination of the permitted discharge;
- e. The permittee's discharge threatens human life or welfare or the maintenance of water quality standards;
- f. Permanent closure of the facility generating the wastewater permitted to be discharged by this permit or permanent cessation of wastewater discharge;
- g. New or revised requirements of any applicable standard or limitation that is promulgated under Sections 301(b)(2)(C), (D), (E), and (F), and 307(a)(2) of the FWPCA that the Director determines cannot be complied with by the permittee.
- h. Any other cause allowed by the ADEM Administrative Code, Chapter 335-6-6.

6. Suspension

This permit may be suspended during its term for noncompliance until the Permittee has taken action(s) necessary to achieve compliance.

7. Stay

The filing of a request by the permittee for modification, suspension or revocation of this permit, in whole or in part, does not stay any permit term or condition.

F. COMPLIANCE WITH TOXIC POLLUTANT STANDARD OR PROHIBITION

If any applicable effluent standard or prohibition (including any schedule of compliance specified in such effluent standard or prohibition) is established under Section 307(a) of the FWPCA, 33 U.S.C. Section 1317(a), for a toxic pollutant discharged by the Permittee and such standard or prohibition is more stringent than any discharge limitation on the pollutant specified in Provision I. A. of this permit, or controls a pollutant not limited in Provision I. A. of this permit, this permit shall be modified to conform to the toxic pollutant effluent standard or prohibition and the Permittee shall be notified of such modification. If this permit has not been modified to conform to the toxic pollutant effluent standard or prohibition before the effective date of such standard or prohibition, the Permittee shall attain compliance with the requirements of the standard or prohibition within the time period required by the standard or prohibition and shall continue to comply with the standard or prohibition until this permit is modified or reissued.

G. NOTICE TO DIRECTOR OF INDUSTRIAL USERS

- 1. The Permittee shall not allow the introduction of wastewater, other than domestic wastewater, from a new direct discharger prior to approval and permitting, if applicable, of the discharge by the Department.
- 2. The Permittee shall not allow an existing indirect discharger to increase the quantity or change the character of its wastewater, other than domestic wastewater, prior to approval and permitting, if applicable, of the increased discharge by the Department.

3. The Permittee shall report to the Department any adverse impact caused or believed to be caused by an indirect discharger on the treatment process, quality of discharged water or quality of sludge. Such report shall be submitted within seven days of the Permittee becoming aware of the adverse impacts.

H. PROHIBITIONS

The Permittee shall not allow, and shall take effective enforcement action to prevent and terminate, the introduction of any of the following into its treatment works by industrial users:

1. Pollutants which create a fire or explosion hazard in the treatment works;
2. Pollutants which will cause corrosive structural damage to the treatment works, or dischargers with a pH lower than 5.0 s.u., unless the works are specifically designed to accommodate such discharges;
3. Solid or viscous pollutants in amounts which will cause obstruction of flow in sewers, or other interference with the treatment works;
4. Pollutants, including oxygen demanding pollutants, released in a discharge of such volume or strength as to cause interference in the treatment works;
5. Heat in amounts which will inhibit biological activity in the treatment plant resulting in interference or in such quantities that the temperature of the treatment plant influent exceeds 40°C (104° F) unless the treatment plant is designed to accommodate such heat;
6. Pollutants in amounts which exceed any applicable pretreatment standard under Section 307 of FWPCA or any approved revisions thereof.

PART III ADDITIONAL REQUIREMENTS, CONDITIONS, AND LIMITATIONS

A. CIVIL AND CRIMINAL LIABILITY

1. Tampering

Any person who falsifies, tampers with, or knowingly renders inaccurate any monitoring device or method required to be maintained or performed under the permit shall, upon conviction, be subject to penalties as provided by the AWPCA.

2. False Statements

Any person who knowingly makes any false statement, representation, or certification in any record or other document submitted or required to be maintained under this permit, including monitoring reports or reports of compliance or noncompliance shall, upon conviction, be subject to penalties as provided by the AWPCA.

3. Permit Enforcement

- a. Any NPDES permit issued or reissued by the Department is a permit for the purpose of the AWPCA and the FWPCA and as such any terms, conditions, or limitations of the permit are enforceable under state and federal law.
- b. Any person required to have a NPDES permit pursuant to ADEM Administrative Code Chapter 335-6-6 and who discharges pollutants without said permit, who violates the conditions of said permit, who discharges pollutants in a manner not authorized by the permit, or who violates applicable orders of the Department or any applicable rule or standard of the Department, is subject to any one or combination of the following enforcement actions under applicable state statutes.
 - (1) An administrative order requiring abatement, compliance, mitigation, cessation, clean-up, and/or penalties;
 - (2) An action for damages;
 - (3) An action for injunctive relief; or
 - (4) An action for penalties.
- c. If the permittee is not in compliance with the conditions of an expiring or expired permit the Director may choose to do any or all of the following provided the permittee has made a timely and complete application for reissuance of the permit:
 - (1) Initiate enforcement action based upon the permit which has been continued;
 - (2) Issue a notice of intent to deny the permit reissuance. If the permit is denied, the owner or operator would then be required to cease the activities authorized by the continued permit or be subject to enforcement action for operating without a permit;
 - (3) Reissue the new permit with appropriate conditions; or
 - (4) Take other actions authorized by these rules and AWPCA.

4. Relief from Liability

Except as provided in Provision II. C. 1. (Bypass) and Provision II. C. 2. (Upset), nothing in this permit shall be construed to relieve the Permittee of civil or criminal liability under the AWPCA or FWPCA for noncompliance with any term or condition of this permit.

B. OIL AND HAZARDOUS SUBSTANCE LIABILITY

Nothing in this permit shall be construed to preclude the institution of any legal action or relieve the Permittee from any responsibilities, liabilities or penalties to which the Permittee is or may be subject under Section 311 of the FWPCA, 33 U.S.C. Section 1321.

C. PROPERTY AND OTHER RIGHTS

This permit does not convey any property rights in either real or personal property, or any exclusive privileges, nor does it authorize any injury to persons or property or invasion of other private rights, or any infringement of federal, state, or local laws or regulations, nor does it authorize or approve the construction of any physical structures or facilities or the undertaking of any work in any waters of the state or of the United States.

D. AVAILABILITY OF REPORTS

Except for data determined to be confidential under Code of Alabama 1975, Section 22-22-9(c), all reports prepared in accordance with the terms of this permit shall be available for public inspection at the offices of the Department. Effluent data shall not be considered confidential.

E. EXPIRATION OF PERMITS FOR NEW OR INCREASED DISCHARGES

1. If this permit was issued for a new discharger or new source, this permit shall expire eighteen months after the issuance date if construction of the facility has not begun during the eighteen-month period.
2. If this permit was issued or modified to allow the discharge of increased quantities of pollutants to accommodate the modification of an existing facility and if construction of this modification has not begun during the eighteen month period after issuance of this permit or permit modification, this permit shall be modified to reduce the quantities of pollutants allowed to be discharged to those levels that would have been allowed if the modification of the facility had not been planned.
3. Construction has begun when the owner or operator has:
 - a. Begun, or caused to begin as part of a continuous on-site construction program:
 - (1) Any placement, assembly, or installation of facilities or equipment; or
 - (2) Significant site preparation work including clearing, excavation, or removal of existing buildings, structures, or facilities which are necessary for the placement, assembly, or installation of new source facilities or equipment; or
 - b. Entered into a binding contractual obligation for the purpose of placement, assembly, or installation of facilities or equipment which are intended to be used in its operation within a reasonable time. Options to purchase or contracts which can be terminated or modified without substantial loss, and contracts for feasibility, engineering, and design studies do not constitute a contractual obligation under this paragraph.
4. Final plans and specifications for a waste treatment facility at a new source or new discharger, or a modification to an existing waste treatment facility must be submitted to and examined by the Department prior to initiating construction of such treatment facility by the Permittee.
5. Upon completion of construction of waste treatment facilities and prior to operation of such facilities, the Permittee shall submit to the Department a certification from a registered professional engineer, licensed to practice in the State of Alabama, that the treatment facilities have been built according to plans and specifications submitted to and examined by the Department.

F. COMPLIANCE WITH WATER QUALITY STANDARDS

1. On the basis of the permittee's application, plans, or other available information, the Department has determined that compliance with the terms and conditions of this permit should assure compliance with the applicable water quality standards.
2. Compliance with permit terms and conditions notwithstanding, if the permittee's discharge(s) from point sources identified in Provision I. A. of this permit cause or contribute to a condition in contravention of state water quality standards, the Department may require abatement action to be taken by the Permittee in emergency situations or modify the permit pursuant to the Department's Rules, or both.
3. If the Department determines, on the basis of a notice provided pursuant to this permit or any investigation, inspection or sampling, that a modification of this permit is necessary to assure maintenance of water quality standards or compliance with other provisions of the AWPCA or FWPCA, the Department may require such modification and, in cases of emergency, the Director may prohibit the discharge until the permit has been modified.

G. GROUNDWATER

Unless specifically authorized under this permit, this permit does not authorize the discharge of pollutants to groundwater. Should a threat of groundwater contamination occur, the Director may require groundwater monitoring to properly assess the degree of the problem, and the Director may require that the Permittee undertake measures to abate any such discharge and/or contamination.

H. DEFINITIONS

1. Average monthly discharge limitation – means the highest allowable average of "daily discharges" over a calendar month, calculated as the sum of all "daily discharges" measured during a calendar month divided by the number of "daily discharges" measured during that month (zero discharge days shall not be included in the number of "daily discharges" measured and a less than detectable test result shall be treated as a concentration of zero if the most sensitive EPA approved method was used).
2. Average weekly discharge limitation - means the highest allowable average of "daily discharges" over a calendar week, calculated as the sum of all "daily discharges" measured during a calendar week divided by the number of "daily discharges" measured during that week (zero discharge days shall not be included in the number of "daily discharges" measured and a less than detectable test result shall be treated as a concentration of zero if the most sensitive EPA approved method was used).
3. Arithmetic Mean – means the summation of the individual values of any set of values divided by the number of individual values.
4. AWPCA – means the Alabama Water Pollution Control Act.
5. BOD – means the five-day measure of the pollutant parameter biochemical oxygen demand.
6. Bypass – means the intentional diversion of waste streams from any portion of a treatment facility.
7. CBOD – means the five-day measure of the pollutant parameter carbonaceous biochemical oxygen demand.
8. Daily discharge – means the discharge of a pollutant measured during any consecutive 24-hour period in accordance with the sample type and analytical methodology specified by the discharge permit.
9. Daily maximum – means the highest value of any individual sample result obtained during a day.
10. Daily minimum – means the lowest value of any individual sample result obtained during a day.
11. Day – means any consecutive 24-hour period.
12. Department – means the Alabama Department of Environmental Management.
13. Director – means the Director of the Department.
14. Discharge – means "[t]he addition, introduction, leaking, spilling or emitting of any sewage, industrial waste, pollutant or other waste into waters of the state". Code of Alabama 1975, Section 22-22-1(b)(9).
15. Discharge Monitoring Report (DMR) – means the form approved by the Director to accomplish reporting requirements of an NPDES permit.
16. DO – means dissolved oxygen.
17. 8HC – means 8-hour composite sample, including any of the following:
 - a. The mixing of at least 8 equal volume samples collected at constant time intervals of not more than 1 hour over a period of not less than 8 hours between the hours of 6:00 a.m. and 6:00 p.m. If the sampling period exceeds 8 hours, sampling may be conducted beyond the 6:00 a.m. to 6:00 p.m. period.
 - b. A sample continuously collected at a constant rate over period of not less than 8 hours between the hours of 6:00 a.m. and 6:00 p.m. If the sampling period exceeds 8 hours, sampling may be conducted beyond the 6:00 a.m. to 6:00 p.m. period.
18. EPA – means the United States Environmental Protection Agency.
19. FC – means the pollutant parameter fecal coliform.

20. Flow – means the total volume of discharge in a 24-hour period.
21. FWPCA – means the Federal Water Pollution Control Act.
22. Geometric Mean – means the Nth root of the product of the individual values of any set of values where N is equal to the number of individual values. The geometric mean is equivalent to the antilog of the arithmetic mean of the logarithms of the individual values. For purposes of calculating the geometric mean, values of zero (0) shall be considered one (1).
23. Grab Sample – means a single influent or effluent portion which is not a composite sample. The sample(s) shall be collected at the period(s) most representative of the discharge.
24. Indirect Discharger – means a nondomestic discharger who discharges pollutants to a publicly owned treatment works or a privately owned treatment facility operated by another person.
25. Industrial User – means those industries identified in the Standard Industrial Classification manual, Bureau of the Budget 1967, as amended and supplemented, under the category “Division D – Manufacturing” and such other classes of significant waste producers as, by regulation, the Director deems appropriate.
26. MGD – means million gallons per day.
27. Monthly Average – means the arithmetic mean of all the composite or grab samples taken for the daily discharges collected in one month period. The monthly average for flow is the arithmetic mean of all flow measurements taken in a one month period.
28. New Discharger – means a person, owning or operating any building, structure, facility or installation:
 - a. From which there is or may be a discharge of pollutants;
 - b. From which the discharge of pollutants did not commence prior to August 13, 1979, and which is not a new source; and
 - c. Which has never received a final effective NPDES permit for dischargers at that site.
29. NH3-N – means the pollutant parameter ammonia, measured as nitrogen.
30. Notifiable sanitary sewer overflow – means an overflow, spill, release or diversion of wastewater from a sanitary sewer system that:
 - a. Reaches a surface water of the State; or
 - b. May imminently and substantially endanger human health based on potential for public exposure including but not limited to close proximity to public or private water supply wells or in areas where human contact would be likely to occur.
31. Permit application – means forms and additional information that is required by ADEM Administrative Code Rule 335-6-6-.08 and applicable permit fees.
32. Point source – means “any discernible, confined and discrete conveyance, including but not limited to any pipe, channel, ditch, tunnel, conduit, well, discrete fissure, container, rolling stock, concentrated animal feeding operation, or vessel or other floating craft, . . . from which pollutants are or may be discharged.” Section 502(14) of the FWPCA, 33 U.S.C. Section 1362(14).
33. Pollutant – includes for purposes of this permit, but is not limited to, those pollutants specified in Code of Alabama 1975, Section 22-22-1(b)(3) and those effluent characteristics specified in Provision I. A. of this permit.
34. Privately Owned Treatment Works – means any devices or system which is used to treat wastes from any facility whose operator is not the operator of the treatment works, and which is not a “POTW”.
35. Publicly Owned Treatment Works – means a wastewater collection and treatment facility owned by the State, municipality, regional entity composed of two or more municipalities, or another entity created by the State or local authority for the purpose of collecting and treating municipal wastewater.
36. Receiving Stream – means the “waters” receiving a “discharge” from a “point source”.
37. Severe property damage – means substantial physical damage to property, damage to the treatment facilities which causes them to become inoperable, or substantial and permanent loss of natural resources

which can reasonably be expected to occur in the absence of a bypass. Severe property damage does not mean economic loss caused by delays in production.

38. Significant Source – means a source which discharges 0.025 MGD or more to a POTW or greater than five percent of the treatment work's capacity, or a source which is a primary industry as defined by the U.S. EPA or which discharges a priority or toxic pollutant.
39. TKN – means the pollutant parameter Total Kjeldahl Nitrogen.
40. TON – means the pollutant parameter Total Organic Nitrogen.
41. TRC – means Total Residual Chlorine.
42. TSS – means the pollutant parameter Total Suspended Solids.
43. 24HC – means 24-hour composite sample, including any of the following:
 - a. The mixing of at least 8 equal volume samples collected at constant time intervals of not more than 2 hours over a period of 24 hours;
 - b. A sample collected over a consecutive 24-hour period using an automatic sampler composite to one sample. As a minimum, samples shall be collected hourly and each shall be no more than one twenty-fourth (1/24) of the total sample volume collected; or
 - c. A sample collected over a consecutive 24-hour period using an automatic composite sampler composited proportional to flow.
44. Upset – means an exceptional incident in which there is an unintentional and temporary noncompliance with technology-based permit discharge limitations because of factors beyond the reasonable control of the Permittee. An upset does not include noncompliance to the extent caused by operational error, improperly designed treatment facilities, inadequate treatment facilities, lack of preventive maintenance, or careless or improper operation.
45. Waters – means "[a]ll waters of any river, stream, watercourse, pond, lake, coastal, ground, or surface water, wholly or partially within the state, natural or artificial. This does not include waters which are entirely confined and retained completely upon the property of a single individual, partnership, or corporation unless such waters are used in interstate commerce." Code of Alabama 1975, Section 22-22-1(b)(2). Waters "include all navigable waters" as defined in Section 502(7) of the FWPCA, 22 U.S.C. Section 1362(7), which are within the State of Alabama.
46. Week -- means the period beginning at twelve midnight Saturday and ending at twelve midnight the following Saturday.
47. Weekly (7-day and calendar week) Average – is the arithmetic mean of all samples collected during a consecutive 7-day period or calendar week, whichever is applicable. The calendar week is defined as beginning on Sunday and ending on Saturday. Weekly averages shall be calculated for all calendar weeks with Saturdays in the month. If a calendar week overlaps two months (i.e., the Sunday is in one month and the Saturday in the following month), the weekly average calculated for the calendar week shall be included in the data for the month that contains the Saturday.

I. SEVERABILITY

The provisions of this permit are severable, and if any provision of this permit or the application of any provision of this permit to any circumstance is held invalid, the application of such provision to other circumstances, and the remainder of this permit, shall not be affected thereby.

PART IV SPECIFIC REQUIREMENTS, CONDITIONS, AND LIMITATIONS

A. SLUDGE MANAGEMENT PRACTICES

1. Applicability
 - a. Provisions of Provision IV.A. apply to a sewage sludge generated or treated in treatment works that is applied to agricultural and non-agricultural land, or that is otherwise distributed, marketed, incinerated, or disposed in landfills or surface disposal sites.
 - b. Provisions of Provision IV.A. do not apply to:
 - (1) Sewage sludge generated or treated in a privately owned treatment works operated in conjunction with industrial manufacturing and processing facilities and which receive no domestic wastewater.
 - (2) Sewage sludge that is stored in surface impoundments located at the treatment works prior to ultimate disposal.
2. Submitting Information
 - a. If applicable, the permittee must submit annually with its Municipal Water Pollution Prevention (MWPP) report the following:
 - (1) Type of sludge stabilization/digestion method;
 - (2) Daily or annual sludge production (dry weight basis);
 - (3) Ultimate sludge disposal practice(s).
 - b. The permittee shall provide sludge inventory data to the Director as requested. These data may include, but are not limited to, sludge quantity and quality reported in Provision IV.A.2.a as well as other specific analyses required to comply with State and Federal laws regarding solid and hazardous waste disposal.
 - c. The permittee shall give prior notice to the Director of at least 30 days of any change planned in the permittee's sludge disposal practices.
3. Reopener or Modification
 - a. Upon review of information provided by the permittee as required by Provision IV.A.2. or, based on the results of an on-site inspection, the permit shall be subject to modification to incorporate appropriate requirements.
 - b. If an applicable "acceptable management practice" or if a numerical limitation for a pollutant in sewage sludge promulgated under Section 405 of FWPCA is more stringent than the sludge pollutant limit or acceptable management practice in this permit, this permit shall be modified or revoked or reissued to conform to requirements promulgated under Section 405. The permittee shall comply with the limitations no later than the compliance deadline specified in applicable regulations as required by Section 405 of FWPCA.

B. EFFLUENT TOXICITY LIMITATIONS AND BIOMONITORING REQUIREMENTS FOR CHRONIC TOXICITY

1. Chronic Toxicity Test
 - a. The permittee shall perform short-term chronic toxicity tests on the wastewater at Outfall 0011.
 - b. The samples shall be diluted using appropriate control water to the Instream Waste Concentration (IWC) which is **92 percent** effluent. The IWC is the actual concentration of effluent, after mixing, in the receiving stream during a 7-day, 10-year low flow period.
 - c. Any test result that shows a statistically significant reduction in survival, growth, or reproduction between the control and test samples at the 95% confidence level indicates chronic toxicity and shall constitute noncompliance with this permit.

2. General Test Requirements

- a. A minimum of three (3) 24-hour composite samples shall be obtained for use in the above biomonitoring tests. Samples shall be collected every other day so that the laboratory receives water samples on the first, third, and fifth day of the seven-day test period. The holding time for each composite sample shall not exceed 36 hours. The control water shall be a water prepared in the laboratory in accordance with the EPA procedure described in EPA 821-R-02-013 (most current edition) or another control water selected by the Permittee and approved by the Department.
- b. Test results shall be deemed unacceptable and the Permittee shall rerun the tests as soon as practical within the monitoring period for the following:
 - (1) For testing with *P. promelas*., effluent toxicity tests with control survival of less than 80% or if dry weight per surviving control organism is less than 0.25 mg;
 - (2) For testing with *C. dubia*., if the number of young per surviving control organism is less than 15 or if less than 60% of surviving control females produce three broods; or
 - (3) If the other requirements of the EPA Test Procedure are not met.
- c. In the event of an invalid test, upon subsequent completion of a valid test, the results of all tests, valid and invalid, are to be reported to the Department along with an explanation of the tests performed and the test results.
- d. Toxicity testing shall be conducted quarterly in the months of **JANUARY, APRIL, JULY and OCTOBER**. Should results from the Quarterly Toxicity test indicate that Outfall 001-1 exhibits chronic toxicity, then the Permittee must conduct the follow-up testing described in Part IV.B.4.a. In addition, should the results from four consecutive testing periods indicate that Outfall 0011 does not exhibit chronic toxicity, the Permittee may automatically reduce the testing frequency to annual, during the month of OCTOBER

3. Reporting Requirements

- a. The Permittee shall notify the Department in writing within 48 hours after toxicity has been demonstrated by the scheduled test(s).
- b. Biomonitoring test results obtained during each monitoring period shall be summarized and reported using the appropriate Discharge Monitoring Report (DMR) form approved by the Department. In accordance with Section 2 of this part, an effluent toxicity report containing the information in Sections 2 and 6 shall be included with the DMR. Two copies of the test results must be submitted to the Department no later than 28 days after the month that tests were performed.

4. Additional Testing Requirements

- a. If chronic toxicity is indicated (i.e., noncompliance with permit limit), then the Permittee must perform two additional valid chronic toxicity tests in accordance with these procedures to determine the extent and duration of the toxic condition. The toxicity tests shall run consecutively beginning on the first calendar week following the date that the Permittee became aware of the permit noncompliance. The results of these follow-up tests shall be submitted to the Department no later than 28 days following the month the tests were performed.
- b. After evaluation of the results of the follow-up tests, the Department will determine if additional action is appropriate and may require additional testing and/or toxicity reduction measures. The permittee may be required to perform a Toxicity Identification Evaluation (TIE) and/or a Toxicity Reduction Evaluation (TRE). The TIE/TRE shall be performed in accordance with the most recent protocols and guidance outlined by EPA (e.g., EPA/600/2-88/062, EPA/600/R-92/080, EPA/600/R-91-003, EPA/600/R-92/081, EPA/833/B-99/022, and/or EPA/600/6-91/005F)

5. Test Methods

The tests shall be performed in accordance with the latest edition of the "EPA Short-Term Methods for Estimating the Chronic Toxicity of Effluents and Receiving Waters to Freshwater Organisms." The Larval Survival and Growth Test, Method 1000.0, shall be used for the fathead minnow (*Pimephales promelas*) test and the Survival and Reproduction Test, Method 1002.0, shall be used for the cladoceran (*Ceriodaphnia dubia*) test.

6. Effluent Toxicity Testing Reports

The following information shall be submitted with each DMR unless otherwise directed by the Department. The Department may at any times suspend or reinstate this requirement or may decrease or increase the frequency of submittals.

- a. Introduction

- (1) Facility name, location and county
 - (2) Permit number
 - (3) Toxicity testing requirements of permit
 - (4) Name of receiving water body
 - (5) Contract laboratory information (if tests are performed under contract)
 - (a) Name of firm
 - (b) Telephone number
 - (c) Address
 - (6) Objective of test
- b. Plant Operations
- (1) Discharge Operating schedule (if other than continuous)
 - (2) Volume of discharge during sample collection to include Mean daily discharge on sample collection dates (MGD, CFS, GPM)
 - (3) Design flow of treatment facility at time of sampling
- c. Source of Effluent and Dilution Water
- (1) Effluent samples
 - (a) Sampling point
 - (b) Sample collection dates and times (to include composite sample start and finish times)
 - (c) Sample collection method
 - (d) Physical and chemical data of undiluted effluent samples (water temperature, pH, alkalinity, hardness, specific conductance, total residual chlorine (if applicable), etc.)
 - (e) Lapsed time from sample collection to delivery
 - (f) Lapsed time from sample collection to test initiation
 - (g) Sample temperature when received at the laboratory
 - (2) Dilution Water
 - (a) Source
 - (b) Collection/preparation date(s) and time(s)
 - (c) Pretreatment (if applicable)
 - (d) Physical and chemical characteristics (water temperature, pH, alkalinity, hardness, specific conductance, etc.)
- d. Test Conditions
- (1) Toxicity test method utilized
 - (2) End point(s) of test
 - (3) Deviations from referenced method, if any, and reason(s)
 - (4) Date and time test started
 - (5) Date and time test terminated
 - (6) Type and volume of test chambers
 - (7) Volume of solution per chamber
 - (8) Number of organisms per test chamber
 - (9) Number of replicate test chambers per treatment
 - (10) Test temperature, pH, and dissolved oxygen as recommended by the method (to include ranges)
 - (11) Specify if aeration was needed
 - (12) Feeding frequency, amount, and type of food
 - (13) Specify if (and how) pH control measures were implemented
 - (14) Light intensity (mean)
- e. Test Organisms
- (1) Scientific name
 - (2) Life stage and age
 - (3) Source
 - (4) Disease(s) treatment (if applicable)
- f. Quality Assurance
- (1) Reference toxicant utilized and source
 - (2) Date and time of most recent chronic reference toxicant test(s), raw data, and current control chart(s). (The most recent chronic reference toxicant test shall be conducted within 30 days of the routine.)
 - (3) Dilution water utilized in reference toxicant test

- (4) Results of reference toxicant test(s) (NOEC, IC25, etc.); report concentration-response relationship and evaluate test sensitivity
- (5) Physical and chemical methods utilized

g. Results

- (1) Provide raw toxicity data in tabular form, including daily records of affected organisms in each concentration (including controls) and replicate
- (2) Provide table of endpoints: NOECs, IC25s, PASS/FAIL, etc. (as required in the applicable NPDES permit)
- (3) Indicate statistical methods used to calculate endpoints
- (4) Provide all physical and chemical data required by method
- (5) Results of test(s) (NOEC, IC25, PASS/FAIL, etc.), report concentration-response relationship (definitive test only), report percent minimum significant difference (PMSD) calculated for sublethal endpoints determined by hypothesis testing.

h. Conclusions and Recommendations

- (1) Relationship between test endpoints and permit limits
- (2) Actions to be taken

1/ Adapted from "Short-Term Methods for Estimating the Chronic Toxicity of Effluents and Receiving Waters to Freshwater Organisms", Fourth Edition, October 2002 (EPA 821-R-02-013), Section 10, Report Preparation.

C. TOTAL RESIDUAL CHLORINE (TRC) REQUIREMENTS

1. If chlorine is not utilized for disinfection purposes, TRC monitoring under Part I of this Permit is not required. If TRC monitoring is not required, "NODI = 9" (conditional monitoring) should be reported on the DMR forms.
2. Testing for TRC shall be conducted according to either the amperometric titration method or the DPD colorimetric method as specified in Section 408(C) or (E), Standards Methods for the Examination of Water and Wastewater, 18th edition. If chlorine is not detected prior to actual discharge to the receiving stream using one of these methods (i.e., the analytical result is less than the detection level), the Permittee shall report on the DMR form "NODI = B" or "0". The Permittee shall then be considered to be in compliance with the daily maximum concentration limit for TRC.
3. This permit contains a maximum allowable TRC level in the effluent. The Permittee is responsible for determining the minimum TRC level needed in the chlorine contact chamber to comply with E.coli limits. The effluent shall be dechlorinated if necessary to meet the maximum allowable effluent TRC level.
4. The sample collection point for effluent TRC shall be at a point downstream of the chlorine contact chamber (downstream of dechlorination if applicable). The exact location is to be approved by the Director.

D. PLANT CLASSIFICATION

The Permittee shall report to the Director within 30 days of the effective date of this permit, the name, address and operator number of the certified wastewater operator in responsible charge of the facility. Unless specified elsewhere in this permit, this facility shall be classified in accordance with ADEM Admin. Code R. 335-10-1-.03.

E. POLLUTANT SCANS

The Permittee shall sample and analyze for the pollutants listed in 40 CFR 122 Appendix J Table 2 once the Permittee starts discharging into Line Creek. The Permittee shall provide data from a minimum of three samples collected within the four and one half years prior to submitting a permit application. Samples must be representative of the seasonal variation in the discharge from each outfall.

ALABAMA DEPARTMENT OF ENVIRONMENTAL MANAGEMENT
WATER DIVISION – INDUSTRIAL AND MUNICIPAL SECTIONS
NONCOMPLIANCE NOTIFICATION FORM

PERMITTEE NAME: _____ PERMIT NO: _____
FACILITY LOCATION: _____
DMR REPORTING PERIOD: _____

1. DESCRIPTION OF DISCHARGE: (Include outfall number (s))
2. DESCRIPTION OF NON-COMPLIANCE: (Attach additional pages if necessary):

LIST EFFLUENT VIOLATIONS (If applicable)			
Outfall Number (s)	NONCOMPLIANCE PARAMETER(S)	Result Reported (Include units)	Permit Limit (Include units)

LIST MONITORING / REPORTING VIOLATIONS (If applicable)		
Outfall Number (s)	NONCOMPLIANCE PARAMETER(S)	Monitoring / Reporting Violation (Provide description)

3. CAUSE OF NON-COMPLIANCE (Attach additional pages if necessary):
4. PERIOD OF NONCOMPLIANCE: (Include exact date(s) and time(s) or, if not corrected, the anticipated time the noncompliance is expected to continue):
5. DESCRIPTION OF STEPS TAKEN AND/OR BEING TAKEN TO REDUCE OR ELIMINATE THE NONCOMPLYING DISCHARGE AND TO PREVENT ITS RECURRENCE (attach additional pages if necessary):

"I certify under penalty of law that this document and all attachments were prepared under my direction or supervision in accordance with a system designed to assure that qualified personnel properly gather and evaluate the information submitted. Based on my inquiry of the person or persons who manage the system, or those persons directly responsible for gathering the information, the information submitted is, to the best of my knowledge and belief, true, accurate, and complete. I am aware that there are significant penalties for submitting false information, including the possibility of fine and imprisonment for knowing violations."

NAME AND TITLE OF RESPONSIBLE OFFICIAL (type or print)

SIGNATURE OF RESPONSIBLE OFFICIAL / DATE SIGNED

NPDES PERMIT RATIONALE

NPDES Permit No: **AL0079634**

Date: July 12, 2013

Permit Applicant: Alabama Wastewater Systems, Inc.
851 Aviation Parkway
Smyrna, Tennessee 37167

Location: Pine Forest WWTF
Hwy 80 - Line Creek at the Macon/Montgomery County Line
Pike Road, Alabama 36064
Montgomery County

Draft Permit is: Initial Issuance:
Reissuance due to expiration: **X**
Modification of existing permit:
Revocation and Reissuance:

Basis for Limitations: Water Quality Model: CBOD₅, TSS, NH₃N, and DO
Reissuance with no modification: pH, CBOD₅, TSS, NH₃N, and DO
Instream calculation at 7Q10: IWC \approx 92%
Toxicity based: TRC
Secondary Treatment Levels:
Other (described below): E. coli

Design Flow in Million Gallons per Day: 2.0 MGD

Description of Discharge: Outfall Number 0011; Effluent discharge to Line Creek,
which is classified as Fish and Wildlife (F&W).

Discussion: The NPDES permit for Pine Forest Wastewater Treatment Facility that will be discharging treated domestic wastewater to Line Creek is being reissued due to expiration. The permit holder and operator will be Alabama Wastewater Systems, LLC, which is an entity of the Adenus Group, LLC.

The wastewater treatment system consists of a combination of a two cell lagoon with the incoming wastewater being screened septic tank effluent. A membrane plant will be built following the second lagoon cell to add tertiary treatment prior to discharge. The design flow for the plant will be 2.0 MGD. The Pine Forest WWTF also has an Underground Injection Control (UIC) permit (ALSI9951770) that was issued by the Department's UIC Section of Groundwater.

The Permittee is planning to construct concrete basins for a Kabota membrane facility. All the storm water drainage from the treatment system will go to internal ponds remaining from a sand/gravel operation at the site previously. According to the Permittee there would be no storm water point source discharge to the surface waters. Therefore, the requirement for storm water monitoring under the NPDES permit does not apply to this facility since it is not a point discharge issue. Since the storm water would be routed to ponds which may discharge to groundwater, this matter has been referred to the Department's Groundwater Branch.

The discharge limits for Five Day Carbonaceous Biochemical Oxygen Demand (CBOD₅), Total Ammonia Nitrogen (NH₃-N), Total Suspended Solids (TSS), and Dissolved Oxygen (DO) are based on a seasonal Waste Load Allocation (WLA) model performed by the Department's Water Quality Branch on September 21, 2007.

This permit imposes seasonal discharge limits for most parameters. Based on the WLA model, the monthly average CBOD₅ limit for the summer and winter seasons are 4.0 mg/L and 12.0 mg/L, respectively. The monthly average NH₃-N limit is 1.0 mg/L for the summer and 3.0 mg/L for the winter. This permit also imposes a daily minimum DO limit of 6.0 mg/L.

The monthly average TSS limit is established at 24.0 mg/L; this limit is based upon the background level in the ecoregion of the receiving water and until a Total Maximum Daily Load (TMDL) can define an allowable load. 40 CFR 133.103(d) allows for a lower percent removal requirement or a mass loading limit for the normally applicable percent removal requirements for less concentrated influent wastewater for separate sewers. Since the influent wastewater is screened septic tank effluent, it is appropriate to not include CBOD₅ and TSS percent removal limits in this permit.

The pH limits were developed in accordance with the Water-Use designation of the receiving stream and the Municipal Section's Permit Development Guidance. The daily minimum and maximum pH limits of 6.0 s.u. and 8.5 s.u. have not changed from the previous permit.

The Department amended ADEM Administrative Code R.335-6-10-.09 to change the bacterial indicator organisms and associated criteria for non-coastal waters from fecal coliform to *Escherichia coli* (E. coli) to be consistent with the United States Environmental Protection Agency (EPA) recommendations for protection against water-borne illnesses. As a result, this permit includes E. coli limits that are consistent with the revised regulations.

The imposed E. coli limits were determined based on the water-use classification of the receiving stream. Since Line Creek is classified as Fish & Wildlife, the E. coli limits for summer (June through September) are 126 col/100 mL (monthly average) and 487 col/100 mL (daily maximum), while the limits for the winter (October through May) are 548 col/ 100 mL (monthly average) and 2507 col/100 mL (daily maximum).

According to the Permittee's application the facility will be using ultraviolet (UV) radiation for disinfection purposes; however, monthly average and daily maximum limits of 0.012 mg/L and 0.021 mg/L for Total Residual Chlorine (TRC) are included in the permit should chlorine disinfection be utilized. The TRC limits were developed based on EPA suggested WQ criteria and the Department's Permit Development Rationale, and should be protective of acute and chronic toxicity criteria in the receiving stream. If monitoring is not applicable during the monitoring period, enter "NODI=9" on the monthly DMR.

The permit imposes monthly monitoring for the following nutrient-related parameters: Total Kjeldahl Nitrogen, Total Phosphorus, and Nitrate plus Nitrite-Nitrogen. Monitoring is imposed for these nutrient-related parameters so that sufficient information will be available regarding the nutrient contribution from this point source, should it be necessary at some later time to impose nutrient limits on this discharge.

The receiving stream is Line Creek. The stream is listed on the current 2012 303(d) list for siltation and is an impaired Tier I stream; however the stream does not have a State of Alabama TMDL at this time.

The facility is a semi-public and private and has no industrial waste coming to it, but based on the Department's review of the application, the receiving water conditions, and the design flow of the plant

being greater than 1.0 MGD, chronic toxicity testing is warranted. This permit imposes a chronic toxicity testing for both *Ceriodaphnia dubia* and fathead minnows (*Pimephales*) with an IWC \approx 92%. The toxicity tests shall be conducted quarterly for the months of January, April, July, and October.

The monitoring frequency for most parameters is two days per week. The monitoring frequency for nutrient-related parameters is once per month. Flow is to be monitored continuously as in the previous permit.

ADEM Administrative Rule 335-6-10-.12 requires applicants to new or expanded discharges to Tier II waters demonstrate that the proposed discharge is necessary for important economic or social development in the area in which the waters are located. The application submitted by the facility is not for a new discharge and discharges to a Tier II water, so the applicant is not required to demonstrate that the discharge is necessary for economic and social development.

Prepared by: S. Torbert

TOXICITY AND DISINFECTION RATIONALE

Facility Name:	Pine Forest WWTF	
NPDES Permit Number:	AL0079634	
Receiving Stream:	Line Creek	
Facility Design Flow (Qw):	2.000 MGD	
Receiving Stream 7Q10:	0.300 cfs	
Receiving Stream 1Q10:	0.225 cfs	(Estimated at 0.75 * 7Q10)
Winter Headwater Flow (WHF):	1.30 cfs	
Summer Temperature for CCC:	30 deg. Celsius	
Winter Temperature for CCC:	20 deg. Celsius	
Headwater Background NH3-N Level:	0.11 mg/l	
Receiving Stream pH:	7.0 s.u.	
Headwater Background FC Level (summer):	N/A.	(Only applicable for facilities with diffusers.)
(winter)	N/A.	

The Stream Dilution Ration (SDR) is calculated using the 7Q10 for all stream classifications.

$$\text{Stream Dilution Ration (SDR)} = \frac{Q_w}{7Q10 + Q_w} = 91.16\%$$

AMMONIA TOXICITY LIMITATIONS

Toxicity-based ammonia limits are calculated in accordance with the Ammonia Toxicity Protocol and the General Guidance for *Writing Water Quality Based Toxicity Permits*.

If the Limiting Dilution is less than 1%, the waterbody is considered stream-dominated and the CMC applies.

If the Limiting Dilution is greater than 1%, the waterbody is considered effluent-dominated and the CCC applies.

$$\begin{aligned} \text{Limiting Dilution} &= \frac{Q_w}{7Q10 + Q_w} \\ &= 91.16\% \quad \text{Effluent-Dominated, CCC Applies} \end{aligned}$$

Criterion Maximum Concentration (CMC): $CMC = 0.411 / (1 + 10(7.204 - pH)) + 58.4 / (1 + 10(pH - 7.204))$

Criterion Continuous Concentration (CCC): $CCC = [0.0577 / (1 + 10(7.688 - pH)) + 2.487 / (1 + 10(pH - 7.688))] * \text{Min}[2.85, 1.45 * 10(0.028 * (25 - T))]$

	<u>CMC</u>	<u>CCC</u>
Allowable Summer Instream NH3-N:	36.09 mg/l	2.18 mg/l
Allowable Winter Instream NH3-N:	36.09 mg/l	4.15 mg/l

$$\begin{aligned} \text{Summer NH3-N Toxicity Limit} &= \frac{[(\text{Allowable Instream NH3-N}) * (7Q10 + Q_w)] - [(\text{Headwater NH3-N}) * (7Q10)]}{Q_w} \\ &= 2.4 \text{ mg/l NH3-N at 7Q10} \end{aligned}$$

$$\begin{aligned} \text{Winter NH3-N Toxicity Limit} &= \frac{[(\text{Allowable Instream NH3-N}) * (WHF + Q_w)] - [(\text{Headwater NH3-N}) * (WHF)]}{Q_w} \\ &= 5.9 \text{ mg/l NH3-N at Winter Flow} \end{aligned}$$

The ammonia limits established in the permit will be the lesser of the DO-based ammonia limit (from the wasteload allocation model) or the toxicity limits calculated above.

	<u>DO-based NH3-N limit</u>	<u>Toxicity-based NH3-N limit</u>
Summer	1.00 mg/l NH3-N	2.40 mg/l NH3-N
Winter	3.00 mg/l NH3-N	5.90 mg/l NH3-N

Summer: The DO based limit of 1.00 mg/l NH3-N applies.

Winter: The DO based limit of 3.00 mg/l NH3-N applies.

TOXICITY TESTING REQUIREMENTS (REFERENCE: MUNICIPAL BRANCH TOXICITY PERMITTING STRATEGY)

The following factors trigger toxicity testing requirements:

1. Facility design flow is equal to or greater than 1.0 MGD (major facility).
2. There are significant industrial contributors (SID permits).

Acute toxicity testing is specified for A&I receiving streams, or for stream dilution ratios of 1% or less.

Chronic toxicity testing is specified for all other situations requiring toxicity testing.

Chronic toxicity testing is required

$$\text{Instream Waste Concentration (IWC)} = \frac{Q_w}{7Q_{10} + Q_w} = 91.16\% \quad \text{Note: This number will be rounded up for toxicity testing purposes.}$$

DISINFECTION REQUIREMENTS

Bacteria limits are required, and will be the water quality limit for the receiving stream, except where diffusers are used the limit may be adjusted for the dilution provided by the diffuser.

See the attached Disinfection Guidance for applicable stream standards.

(Non-coastal limits apply)

Applicable Stream Classification: **Fish & Wildlife**

Disinfection Type: **Ultraviolet**

Limit calculation method: **Limits based on meeting stream standards at the point of discharge.**

	Stream Standard (colonies/100ml)	Effluent Limit (colonies/100ml)
<u>E. Coli (applies to Non-coastal and Shellfish Harvesting Coastal)</u>		
Monthly limit as monthly average (October through May):	548	548
Monthly limit as monthly average (June through September):	126	126
Daily Max (October through May):	2507	2507
Daily Max (June through September):	487	487
<u>Enterococci (applies to Coastal)</u>		
Monthly limit as geometric mean (October through May):	Not applicable	Not applicable
Monthly limit as geometric mean (June through September):	Not applicable	Not applicable
Daily Max (October through May):	Not applicable	Not applicable
Daily Max (June through September):	Not applicable	Not applicable

MAXIMUM ALLOWABLE CHLORINATION LIMITS

Toxicity-based chlorine limits are calculated in accordance with the General Guidance for Writing Water Quality Based Toxicity Permits.

Chlorine has been shown to be acutely toxic at 0.019 mg/l and chronically toxic at 0.011 mg/l.

Maximum allowable TRC in effluent:	0.012 mg/L	(0.011)/(SDR)
Maximum allowable TRC in effluent:	0.021 mg/L	(0.019)/(SDR)

NOTE: A maximum chlorine limit will be imposed such that the instream concentration will not exceed acutely toxic concentrations in A & I streams and chronically toxic concentrations in all other streams, but may not exceed 1.0 mg/l.

Prepared By:

S. Torbert

Date:

7/11/2013

FACT SHEET
APPLICATION FOR
NATIONAL POLLUTANT DISCHARGE ELIMINATION SYSTEM
PERMIT TO DISCHARGE TREATED WASTEWATERS
TO WATERS OF THE STATE OF ALABAMA

Date: July 12, 2013

Prepared By: S. Torbert

NPDES Permit No. AL0079634

1. SYNOPSIS OF APPLICATION

a. Name and Address of Applicant and Location if Different From Mailing Address

Applicant Name and Address:
ALABAMA WASTEWATER SYSTEMS,
INC.
851 AVIATION PARKWAY
SMYRNA TN 37167

Facility Location:
Pine Forest WWTF
Hwy 80 - Line Creek at the Macon/Montgomery
County Line
Pike Road, Alabama 36064

b. Description of Applicant's Facility or Activity Generating the Discharge

Major Semi-Public and Private Wastewater Treatment Plant

For the Outfall latitude and longitude see the permit application

c. Applicant's Receiving Waters

Receiving Waters
Line Creek

Classification
F&W

d. Quantitative Description of Proposed Discharges

See attached draft permit and permit application

2. PROPOSED DISCHARGE LIMITATIONS

See attached draft permit

3. STATEMENT OF BASIS FOR PERMIT LIMITATIONS

See attached permit rationale

4. PROCEDURES FOR THE FORMULATION OF FINAL DETERMINATIONS

a. Comment Period

The Alabama Department of Environmental Management proposes to issue an NPDES permit to this applicant subject to the effluent limitations and special conditions outlined above. These determinations are tentative.

Interested persons are invited to submit written comments on the permit application or on proposed determinations to the following address:

Russell A. Kelly, Chief
Permits and Services Division
Alabama Department of Environmental Management
1400 Coliseum Blvd
(Mailing Address: Post Office Box 301463; Zip 36130-1463)
Montgomery, Alabama 36110-2059
(334) 271-7714

All comments received prior to the closure of the public notice period (see attached public notice) will be considered in the formulation of final determinations with regard to this application.

b. Public Hearing

A written request for a public hearing may also be filed with the public notice period and must state the nature of the issues proposed to be raised in the hearing. The Director shall hold a public hearing whenever it is found, on the basis of hearing requests, that there exists a significant degree of public interest in the permit application or draft permit or group of permits. A request for a hearing should be filed with the Department at the following address:

Russell A. Kelly, Chief
Permits and Services Division
Alabama Department of Environmental Management
1400 Coliseum Blvd
(Mailing Address: Post Office Box 301463; Zip 36130-1463)
Montgomery, Alabama 36110-2059
(334) 271-7714

The Director may hold a public hearing if he determines that useful information and data may be obtained thereby. Public notice of such a hearing will be published at least 30 days prior to the hearing in a newspaper having general circulation in the geographical area of the discharge and will be sent to those on the ADEM mailing list at least thirty days prior to the hearing.

c. Issuance of the Permit

Upon the expiration of the comment period and, if applicable, completion of the public hearing process a response to all significant comments will be prepared. After consideration of all comments received during the notice period or as the result of a public hearing, the response to comments, and of the requirements of the Alabama Water Pollution Control Act and appropriate regulations, the Director will make a final decision regarding permit issuance. **The permit record, including the response to comments, will be available to the public and an appointment to review the record may be made by writing the Permits and Services Division at the above address.**

Unless a request for a stay of a permit or permit provision is granted, the proposed permit contained in the Director's determination shall be issued and effective; and will be the final action of the Alabama Department of Environmental Management.

d. Appeal Procedures

Any person adversely affected by the Director's final decision may submit an appeal or a request for a stay of the permit or one or more provisions of the permit. Such requests should be received by the

Environmental Management Commission within thirty days of issuance of the permit. Requests should be submitted to the Chairperson at the following address:

Alabama Environmental Management Commission
1400 Coliseum Blvd
(Mailing Address: Post Office Box 301463; Zip 36130-1463)
Montgomery, Alabama 36110-2059

All requests must:

- (i) State the name, mailing address and telephone number of the person making such request;
- (ii) Identify the interest of the appellant which is affected by the proposed issuance, denial or modification of the permit contained in the determination of the Director, and explain how and to what extent that interest would be directly and adversely affected by such determination;
- (iii) Identify any persons whom the request represents;
- (iv) State with particularity the issues proposed to be considered at the hearing;
- (v) Include any terms and conditions with which the appellant proposes to revise or replace the determinations of the Director;
- (vi) State the name, mailing address and telephone number of the attorney for the person making the request, if represented by an attorney; and
- (vii) An original signature of the person making the request or such person's attorney.

The Commission may rule on the appeal or may hold an appeals hearing prior to making a ruling.

Waste Load Allocation Summary

Comments included

☒ Yes ☐ No

General Information

Information Verified By CCG

Page 1

Receiving Stream Name Line Creek

Year File Was Created 2007

Previous File Name

OR: Local Name (If applicable)

Facility Name Adenus Line Creek WWTP

Previous Discharger Name

Or-AKA (includes previous file name)

11 Digit HUC Code 03150110140

12 Digit HUC Code 031501100903

River Basin Tallapoosa

County Montgomery

Use Classification F&W

Discharge Latitude 32.3791

Discharge Longitude -86.00959

Site Visit Completed? ☒ Yes ☐ No

Date of Site Visit 8/27/2007

Waterbody Impaired? ☒ Yes ☐ No

Antidegradation ☐ Yes ☒ No

Waterbody Tier Level Tier I

Use Support Category 5

Other Point Sources? ☐ Yes ☒ No

Sources Included in Model

Print Record

Close Form

Date of WLA Response 9/21/2007

Lat/Long Method GPS

Approved TMDL?

☐ Yes ☒ No

Approval Date of TMDL

Permit Information

Permit Number

Permit Status Proposed

Type of Discharger

- ☐ Municipal
☐ Industrial
☒ Semipublic/Private
☐ Mining

Waste Load Allocation Information

Modeled Reach Length 7

Miles

Date of Allocation 9/21/2007

Name of Model Used SWQM

Allocation Type 2 Seasons

Model Completed by Chris Goodman

Type of Model Used Desk-top

Allocation Developed by Water Quality Branch

Waste Load Allocation Summary

Annual Effluent Limits	Conventional Parameters				Other Parameters							
	Qw	2	MGD		Qw	2	MGD		Qw	MGD	Qw	MGD
	Season	Summer			Season	Winter			Season		Season	
	From	May			From	Dec			From		From	
	Through	Nov			Through	Apr			Through		Through	
CBOD5				CBOD5	4	mg/L		CBOD5	12	mg/L	TP	
NH3-N				NH3-N	1	mg/L		NH3-N	3	mg/L	TN	
TKN				TKN				TKN			TSS	
D.O.				D.O.	6	mg/L		D.O.	6	mg/L		

"Monitor Only" Parameters for Effluent:		Parameter	Frequency	Parameter	Frequency
		TP	Monthly		
		TN	Monthly		
		NO2+NO3-N	Monthly		

Water Quality Characteristics Immediately Upstream of Discharge

Parameter	Summer		Winter	
CBODu	2	mg/l	2	mg/l
NH3-N	0.11	mg/l	0.11	mg/l
Temperature	30	°C	20	°C
pH	7	su	7	su

Hydrology at Discharge Location

Drainage Area Qualifier	Drainage Area		Method Used to Calculate
Exact	Drainage Area	308	sq mi
	Stream 7Q10	0.3	cfs
	Stream 1Q10		cfs
	Stream 7Q2	1.3	cfs
	Annual Average		cfs
			USGS Estimate


Comments and/or Notations Line Creek is on the 303(d) list for siltation. A TSS background limit of 24 mg/L should be applied.

Please print or type in the unshaded areas only
(fill-in areas are spaced for elite type, i.e., 12 characters/inch).

For Approved. OMB No. 2040-0086. Approval expires 5-31-92

FORM 1 GENERAL		U.S. ENVIRONMENTAL PROTECTION AGENCY GENERAL INFORMATION Consolidated Permits Program (Read the "General Instructions" before starting.)		I. EPA I.D. NUMBER	
LABEL ITEMS				S	T/A
I. EPA I.D. NUMBER				F	C
III. FACILITY NAME				1	2
V. FACILITY MAILING LIST				13	14
VI. FACILITY LOCATION				15	16
PLEASE PLACE LABEL IN THIS SPACE					
II. POLLUTANT CHARACTERISTICS					
INSTRUCTIONS: Complete A through J to determine whether you need to submit any permit application forms to the EPA. If you answer "yes" to any questions, you must submit this form and the supplemental form listed in the parenthesis following the question. Mark "X" in the box in the third column if the supplemental form is attached. If you answer "no" to each question, you need not submit any of these forms. You may answer "no" if your activity is excluded from permit requirements; see Section C of the instructions. See also, Section D of the instructions for definitions of bold-faced terms.					
SPECIFIC QUESTIONS		MARK "X"		SPECIFIC QUESTIONS	
		YES	NO	FORM ATTACHED	
A. Is this facility a publicly owned treatment works which results in a discharge to waters of the U.S.? (FORM 2A)		<input type="checkbox"/>	<input checked="" type="checkbox"/>	<input type="checkbox"/>	
C. Is this facility which currently results in discharges to waters of the U.S. other than those described in A or B above? (FORM 2C)		<input type="checkbox"/>	<input checked="" type="checkbox"/>	<input type="checkbox"/>	
E. Does or will this facility treat, store, or dispose of hazardous wastes? (FORM 3)		<input type="checkbox"/>	<input checked="" type="checkbox"/>	<input type="checkbox"/>	
G. Do you or will you inject at this facility any produced water other fluids which are brought to the surface in connection with conventional oil or natural gas production, inject fluids used for enhanced recovery of oil or natural gas, or inject fluids for storage of liquid hydrocarbons? (FORM 4)		<input type="checkbox"/>	<input checked="" type="checkbox"/>	<input type="checkbox"/>	
I. Is this facility a proposed stationary source which is one of the 28 industrial categories listed in the instructions and which will potentially emit 100 tons per year of any air pollutant regulated under the Clean Air Act and may affect or be located in an attainment area? (FORM 5)		<input type="checkbox"/>	<input checked="" type="checkbox"/>	<input type="checkbox"/>	
B. Does or will this facility (either existing or proposed) include a concentrated animal feeding operation or aquatic animal production facility which results in a discharge to waters of the U.S.? (FORM 2B)		<input type="checkbox"/>	<input checked="" type="checkbox"/>	<input type="checkbox"/>	
D. Is this proposal facility (other than those described in A or B above) which will result in a discharge to waters of the U.S.? (FORM 2D)		<input checked="" type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	
F. Do you or will you inject at this facility industrial or municipal effluent below the lowermost stratum containing, within one quarter mile of the well bore, underground sources of drinking water? (FORM 4)		<input type="checkbox"/>	<input checked="" type="checkbox"/>	<input type="checkbox"/>	
H. Do you or will you inject at this facility fluids for special processes such as mining of sulfur by the Frasch process, solution mining of minerals, in situ combustion of fossil fuel, or recovery of geothermal energy? (FORM 4)		<input type="checkbox"/>	<input checked="" type="checkbox"/>	<input type="checkbox"/>	
J. Is this facility a proposed stationary source which is NOT one of the 28 industrial categories listed in the instructions and which will potentially emit 250 tons per year of any air pollutant regulated under the Clean Air Act and may affect or be located in an attainment area? (FORM 5)		<input type="checkbox"/>	<input checked="" type="checkbox"/>	<input type="checkbox"/>	
III. NAME OF FACILITY					
C. SKIP Pine Forest Treatment Facility					
15 16-29 30 69					
IV. FACILITY CONTACT					
A. NAME & TITLE (last, first, & title)					
C. Pickney, Robert / Chief Technical Officer					
B. PHONE (area code & no.)					
2 615 220 7200					
15 16 45 46 48 49 51 52 55					
V. FACILITY MAILING ADDRESS					
A. STREET OR P.O. BOX					
C. 849 Aviation Parkway					
3 45					
B. CITY OR TOWN					
C. Smyrna					
4 40 41 42 47 51					
C. STATE					
TN					
D. ZIP CODE					
37167					
VI. FACILITY LOCATION					
A. STREET, ROUTE NO. OR OTHER SPECIFIC IDENTIFIER					
C. Hwy 80 AT Line Creek (Montgomery/Macon County Line)					
5 45					
B. COUNTY NAME					
Montgomery					
46 70					
C. CITY OR TOWN					
C. Pike Road					
6 40 41 42 47 51 52 64					
D. STATE					
AL					
E. ZIP CODE					
36064					
F. COUNTY CODE					
51					

CONTINUED FROM THE FRONT

VII. SIC CODES (4-digit, in order of priority)																
A. FIRST										B. SECOND						
C	7	15	16	17	7	15	16	17	18	19	(specify)					
											Wastewater Treatment					
C. THIRD										D. FOURTH						
C	7	15	16	17	7	15	16	17	18	19	(specify)					
VIII. OPERATOR INFORMATION																
A. NAME										B. Is the name listed in Item VIII-A also the owner?						
C	8	18	19	Robert Pickney							<input checked="" type="checkbox"/> YES <input type="checkbox"/> NO					
C. STATUS OF OPERATOR (Enter the appropriate letter into the answer box; if "Other," specify.)										D. PHONE (area code & no.)						
F = FEDERAL	M = PUBLIC (other than federal or state)	P = PRIVATE	O = OTHER (specify)	P	56	Public Utility Company				C	615	220	7200			
S = STATE						A	15	16	18	19	21	22	25			
E. STREET OR PO BOX																
849 Aviation Parkway																
F. CITY OR TOWN										G. STATE		H. ZIP CODE		IX. INDIAN LAND		
C	15	16	17	18	40	TN	42	42	37167	47	51	Is the facility located on Indian lands?				
B												<input type="checkbox"/> YES <input checked="" type="checkbox"/> NO				
X. EXISTING ENVIRONMENTAL PERMITS																
A. NPDES (Discharges to Surface Water)										D. PSD (Air Emissions from Proposed Sources)						
C	9	15	16	17	18	30	N/A	C	9	15	16	17	18	30		
T	N							T	P							
B. UIC (Underground Injection of Fluids)										E. OTHER (specify)						
C	9	15	16	17	18	30	4	C	9	15	16	17	18	30		
T	U							T								
C. RCRA (Hazardous Wastes)										E. OTHER (specify)						
C	9	15	16	17	18	30		C	9	15	16	17	18	30		
T	R							T								
XI. MAP																
Attach to this application a topographic map of the area extending to at least one mile beyond property boundaries. The map must show the outline of the facility, the location of each of its existing and proposed intake and discharge structures, each of its hazardous waste treatment, storage, or disposal facilities, and each well where it injects fluids underground. Include all springs, rivers and other surface water bodies in the map area. See instructions for precise requirements.																
XII. NATURE OF BUSINESS (provide a brief description)																
Wastewater Collection, Treatment and Disposal																
XIII. CERTIFICATION (see instructions)																
I certify under penalty of law that I have personally examined and am familiar with the information submitted in this application and all attachments and that, based on my inquiry of those persons immediately responsible for obtaining the information contained in the application, I believe that the information is true, accurate and complete. I am aware that there are significant penalties for submitting false information, including the possibility of fine and imprisonment.																
A. NAME & OFFICIAL TITLE (type or print)										B. SIGNATURE						
Robert Pickney / Chief Technical Officer																
										C. DATE SIGNED						
										6/17/2013						
COMMENTS FOR OFFICIAL USE ONLY																
C	15	16														
C																

FACILITY NAME AND PERMIT NUMBER:

Pine Forest Treatment Facility/AL0079634

Form Approved 1/14/99
OMB Number 2040-0086**FORM
2A
NPDES****NPDES FORM 2A APPLICATION OVERVIEW****APPLICATION OVERVIEW**


Form 2A has been developed in a modular format and consists of a "Basic Application Information" packet and a "Supplemental Application Information" packet. The Basic Application Information packet is divided into two parts. All applicants must complete Parts A and C. Applicants with a design flow greater than or equal to 0.1 mgd must also complete Part B. Some applicants must also complete the Supplemental Application Information packet. The following items explain which parts of Form 2A you must complete.

BASIC APPLICATION INFORMATION:

- A. Basic Application Information for all Applicants.** All applicants must complete questions A.1 through A.8. A treatment works that discharges effluent to surface waters of the United States must also answer questions A.9 through A.12.
- B. Additional Application Information for Applicants with a Design Flow ≥ 0.1 mgd.** All treatment works that have design flows greater than or equal to 0.1 million gallons per day must complete questions B.1 through B.6.
- C. Certification.** All applicants must complete Part C (Certification).

SUPPLEMENTAL APPLICATION INFORMATION:

- D. Expanded Effluent Testing Data.** A treatment works that discharges effluent to surface waters of the United States and meets one or more of the following criteria must complete Part D (Expanded Effluent Testing Data):
 - 1. Has a design flow rate greater than or equal to 1 mgd,
 - 2. Is required to have a pretreatment program (or has one in place), or
 - 3. Is otherwise required by the permitting authority to provide the information.
- E. Toxicity Testing Data.** A treatment works that meets one or more of the following criteria must complete Part E (Toxicity Testing Data):
 - 1. Has a design flow rate greater than or equal to 1 mgd,
 - 2. Is required to have a pretreatment program (or has one in place), or
 - 3. Is otherwise required by the permitting authority to submit results of toxicity testing.
- F. Industrial User Discharges and RCRA/CERCLA Wastes.** A treatment works that accepts process wastewater from any significant industrial users (SIUs) or receives RCRA or CERCLA wastes must complete Part F (Industrial User Discharges and RCRA/CERCLA Wastes). SIUs are defined as:
 - 1. All industrial users subject to Categorical Pretreatment Standards under 40 Code of Federal Regulations (CFR) 403.6 and 40 CFR Chapter I, Subchapter N (see instructions); and
 - 2. Any other industrial user that:
 - a. Discharges an average of 25,000 gallons per day or more of process wastewater to the treatment works (with certain exclusions); or
 - b. Contributes a process wastestream that makes up 5 percent or more of the average dry weather hydraulic or organic capacity of the treatment plant; or
 - c. Is designated as an SIU by the control authority.
- G. Combined Sewer Systems.** A treatment works that has a combined sewer system must complete Part G (Combined Sewer Systems).

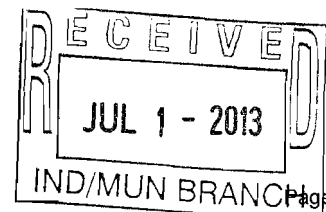ALL APPLICANTS MUST COMPLETE PART C (CERTIFICATION)

FACILITY NAME AND PERMIT NUMBER:

Pine Forest Treatment Facility/AL0079634

Form Approved 1/14/99
OMB Number 2040-0086**BASIC APPLICATION INFORMATION****PART A. BASIC APPLICATION INFORMATION FOR ALL APPLICANTS:**

All treatment works must complete questions A.1 through A.8 of this Basic Application Information packet.

A.1. Facility Information.

Facility name Pine Forest Treatment Facility

Mailing Address 851 Aviation Parkway, Smyrna, TN 37167

Contact person Bob Pickney

Title Chief Technical Officer

Telephone number (615) 220-7200

Facility Address Hwy 80 at Line Creek (Montgomery/Macon County Line), Pike Road, AL 36064
(not P.O. Box)

A.2. Applicant Information. If the applicant is different from the above, provide the following:

Applicant name Alabama Wastewater Systems, Inc.

Mailing Address 851 Aviation Parkway, Smyrna, TN 37167

Contact person Bob Pickney

Title Chief Technical Officer

Telephone number (615) 220-7200

Is the applicant the owner or operator (or both) of the treatment works?

☒ owner ☒ operator

Indicate whether correspondence regarding this permit should be directed to the facility or the applicant.

☒ facility ☐ applicant**A.3. Existing Environmental Permits.** Provide the permit number of any existing environmental permits that have been issued to the treatment works (include state-issued permits).

NPDES AL0079634 PSD _____

UIC ALSI9951770 Other _____

RCRA _____ Other _____

A.4. Collection System Information. Provide information on municipalities and areas served by the facility. Provide the name and population of each entity and, if known, provide information on the type of collection system (combined vs. separate) and its ownership (municipal, private, etc.).

Name	Population Served	Type of Collection System	Ownership
<u>The Waters Development</u>	<u>400</u>	<u>Seperate</u>	<u>Private</u>
<u>Waterscapes Development</u>	<u>200</u>	<u>Seperate</u>	<u>Private</u>
<u>Rural Pike Road Communit</u>	<u>2,000</u>	<u>Seperate</u>	<u>Private</u>
Total population served	<u>2600</u>		

FACILITY NAME AND PERMIT NUMBER:

Pine Forest Treatment Facility/AL0079634

Form Approved 1/14/99
OMB Number 2040-0086

A.5. Indian Country.

- a. Is the treatment works located in Indian Country?

☐ Yes ☒ No

- b. Does the treatment works discharge to a receiving water that is either in Indian Country or that is upstream from (and eventually flows through) Indian Country?

☐ Yes ☒ No

A.6. Flow. Indicate the design flow rate of the treatment plant (i.e., the wastewater flow rate that the plant was built to handle). Also provide the average daily flow rate and maximum daily flow rate for each of the last three years. Each year's data must be based on a 12-month time period with the 12th month of "this year" occurring no more than three months prior to this application submittal.

- a. Design flow rate
- 2.00
- mgd

	<u>Two Years Ago</u>	<u>Last Year</u>	<u>This Year</u>
b. Annual average daily flow rate	<u>0.00</u>	<u>0.00</u>	<u>0.00</u> mgd
c. Maximum daily flow rate	<u>0.00</u>	<u>0.00</u>	<u>0.00</u> mgd

A.7. Collection System. Indicate the type(s) of collection system(s) used by the treatment plant. Check all that apply. Also estimate the percent contribution (by miles) of each.

☒ Separate sanitary sewer 100.00 %
☐ Combined storm and sanitary sewer _____ %

A.8. Discharges and Other Disposal Methods.

- a. Does the treatment works discharge effluent to waters of the U.S.?

☒ Yes ☐ No

If yes, list how many of each of the following types of discharge points the treatment works uses:

i. Discharges of treated effluent 1
ii. Discharges of untreated or partially treated effluent 0
iii. Combined sewer overflow points 0
iv. Constructed emergency overflows (prior to the headworks) 0
v. Other _____ 0

- b. Does the treatment works discharge effluent to basins, ponds, or other surface impoundments that do not have outlets for discharge to waters of the U.S.?

☐ Yes ☒ No

If yes, provide the following for each surface impoundment:

Location: _____

Annual average daily volume discharged to surface impoundment(s) _____ mgd

Is discharge _____ continuous or _____ intermittent?

- c. Does the treatment works land-apply treated wastewater?

☐ Yes ☒ No

If yes, provide the following for each land application site:


Location: _____

Number of acres: _____

Annual average daily volume applied to site: _____ Mgd

Is land application _____ continuous or _____ intermittent?

- d. Does the treatment works discharge or transport treated or untreated wastewater to another treatment works?

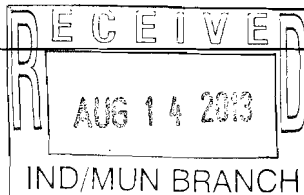☐ Yes ☒ No

FACILITY NAME AND PERMIT NUMBER:

Pine Forest Treatment Facility/AL0079634

Form Approved 1/14/99
OMB Number 2040-0086

If yes, describe the mean(s) by which the wastewater from the treatment works is discharged or transported to the other treatment works (e.g., tank truck, pipe).

If transport is by a party other than the applicant, provide:

Transporter name: _____

Mailing Address: _____

Contact person: _____

Title: _____

Telephone number: _____

For each treatment works that receives this discharge, provide the following:

Name: _____

Mailing Address: _____

Contact person: _____

Title: _____

Telephone number: _____

If known, provide the NPDES permit number of the treatment works that receives this discharge. _____

Provide the average daily flow rate from the treatment works into the receiving facility. _____

mgd

- e. Does the treatment works discharge or dispose of its wastewater in a manner not included in A.8.a through A.8.d above (e.g., underground percolation, well injection)?

____ Yes



No

If yes, provide the following for each disposal method:

Description of method (including location and size of site(s) if applicable):

Annual daily volume disposed of by this method: _____

Is disposal through this method _____ continuous or _____ intermittent?

FACILITY NAME AND PERMIT NUMBER:
Pine Forest Treatment Facility/AL0079634

Form Approved 1/14/99
OMB Number 2040-0086

WASTEWATER DISCHARGES:


If you answered "yes" to question A.8.a, complete questions A.9 through A.12 once for each outfall (including bypass points) through which effluent is discharged. Do not include information on combined sewer overflows in this section. If you answered "no" to question A.8.a, go to Part B, "Additional Application Information for Applicants with a Design Flow Greater than or Equal to 0.1 mgd."

A.9. Description of Outfall.

- a. Outfall number 0011
- b. Location Pike Road 36064
(City or town, if applicable) (Zip Code)
Montgomery AL
(County) (State)
322230 0860030
(Latitude) (Longitude)
- c. Distance from shore (if applicable) 900.00 ft.
- d. Depth below surface (if applicable) _____ ft.
- e. Average daily flow rate 50,000.00 mgd
- f. Does this outfall have either an intermittent or a periodic discharge? ☒ Yes ☐ No (go to A.9.g.)
- If yes, provide the following information:
- Number of times per year discharge occurs: 0
- Average duration of each discharge: 0
- Average flow per discharge: 0.00 mgd
- Months in which discharge occurs: N/A
- g. Is outfall equipped with a diffuser? ☐ Yes ☒ No

A.10. Description of Receiving Waters.

- a. Name of receiving water Line Creek
- b. Name of watershed (if known) Tallapoosa
- United States Soil Conservation Service 14-digit watershed code (if known): _____
- c. Name of State Management/River Basin (if known): Tallapoosa
- United States Geological Survey 8-digit hydrologic cataloging unit code (if known): _____
- d. Critical low flow of receiving stream (if applicable):
acute _____ cfs chronic _____ cfs
- e. Total hardness of receiving stream at critical low flow (if applicable): _____ mg/l of CaCO₃

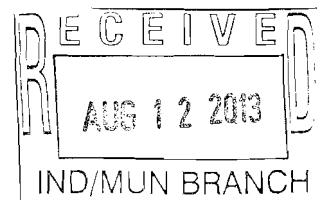

FACILITY NAME AND PERMIT NUMBER:
Pine Forest Treatment Facility/AL0079634

Form Approved 1/14/99
OMB Number 2040-0086

A.11. Description of Treatment.

a. What levels of treatment are provided? Check all that apply.

☒ Primary ☒ Secondary
☒ Advanced ☐ Other. Describe: _____

b. Indicate the following removal rates (as applicable):

Design BOD₅ removal or Design CBOD₅ removal 95.00 %
Design SS removal 98.00 %
Design P removal 10.00 %
Design N removal 75.00 %
Other _____ %

c. What type of disinfection is used for the effluent from this outfall? If disinfection varies by season, please describe.

Ultraviolet

If disinfection is by chlorination, is dechlorination used for this outfall? ☐ Yes ☐ No

d. Does the treatment plant have post aeration? ☐ Yes ☒ No

A.12. Effluent Testing Information. All Applicants that discharge to waters of the US must provide effluent testing data for the following parameters. Provide the indicated effluent testing required by the permitting authority for each outfall through which effluent is discharged. Do not include information on combined sewer overflows in this section. All information reported must be based on data collected through analysis conducted using 40 CFR Part 136 methods. In addition, this data must comply with QA/QC requirements of 40 CFR Part 136 and other appropriate QA/QC requirements for standard methods for analytes not addressed by 40 CFR Part 136. At a minimum, effluent testing data must be based on at least three samples and must be no more than four and one-half years apart.

Outfall number: 0011

PARAMETER	MAXIMUM DAILY VALUE		AVERAGE DAILY VALUE		
	Value	Units	Value	Units	Number of Samples
pH (Minimum)	6.00	s.u.			
pH (Maximum)	8.50	s.u.			
Flow Rate		n/a			
Temperature (Winter)		n/a			
Temperature (Summer)		n/a			

* For pH please report a minimum and a maximum daily value

POLLUTANT	MAXIMUM DAILY DISCHARGE		AVERAGE DAILY DISCHARGE			ANALYTICAL METHOD	ML / MDL
	Conc.	Units	Conc.	Units	Number of Samples		

CONVENTIONAL AND NONCONVENTIONAL COMPOUNDS.

BIOCHEMICAL OXYGEN DEMAND (Report one)	BOD-5		n/a				
	CBOD-5		n/a				
FECAL COLIFORM			n/a				
TOTAL SUSPENDED SOLIDS (TSS)			n/a				

END OF PART A.

REFER TO THE APPLICATION OVERVIEW TO DETERMINE WHICH OTHER PARTS OF FORM 2A YOU MUST COMPLETE

FACILITY NAME AND PERMIT NUMBER:

Pine Forest Treatment Facility/AL0079634

Form Approved 1/14/99
OMB Number 2040-0086**BASIC APPLICATION INFORMATION****PART B. ADDITIONAL APPLICATION INFORMATION FOR APPLICANTS WITH A DESIGN FLOW GREATER THAN OR EQUAL TO 0.1 MGD (100,000 gallons per day).**All applicants with a design flow rate ≥ 0.1 mgd must answer questions B.1 through B.6. All others go to Part C (Certification).**B.1. Inflow and Infiltration.** Estimate the average number of gallons per day that flow into the treatment works from inflow and/or infiltration.0.00 gpd

Briefly explain any steps underway or planned to minimize inflow and infiltration.

B.2. Topographic Map. Attach to this application a topographic map of the area extending at least one mile beyond facility property boundaries. This map must show the outline of the facility and the following information. (You may submit more than one map if one map does not show the entire area.)

- The area surrounding the treatment plant, including all unit processes.
- The major pipes or other structures through which wastewater enters the treatment works and the pipes or other structures through which treated wastewater is discharged from the treatment plant. Include outfalls from bypass piping, if applicable.
- Each well where wastewater from the treatment plant is injected underground.
- Wells, springs, other surface water bodies, and drinking water wells that are: 1) within 1/4 mile of the property boundaries of the treatment works, and 2) listed in public record or otherwise known to the applicant.
- Any areas where the sewage sludge produced by the treatment works is stored, treated, or disposed.
- If the treatment works receives waste that is classified as hazardous under the Resource Conservation and Recovery Act (RCRA) by truck, rail, or special pipe, show on the map where that hazardous waste enters the treatment works and where it is treated, stored, and/or disposed.

B.3. Process Flow Diagram or Schematic. Provide a diagram showing the processes of the treatment plant, including all bypass piping and all backup power sources or redundancy in the system. Also provide a water balance showing all treatment units, including disinfection (e.g., chlorination and dechlorination). The water balance must show daily average flow rates at influent and discharge points and approximate daily flow rates between treatment units. Include a brief narrative description of the diagram.**B.4. Operation/Maintenance Performed by Contractor(s).**Are any operational or maintenance aspects (related to wastewater treatment and effluent quality) of the treatment works the responsibility of a contractor? ☒ Yes ☐ No

If yes, list the name, address, telephone number, and status of each contractor and describe the contractor's responsibilities (attach additional pages if necessary).

Name: Kess EnvironmentalMailing Address: 282 Gilbert Road
Lowndesboro, AL 36752-3003Telephone Number: (334) 868-6442Responsibilities of Contractor: Operate & Maintain Facility**B.5. Scheduled Improvements and Schedules of Implementation.** Provide information on any uncompleted implementation schedule or uncompleted plans for improvements that will affect the wastewater treatment, effluent quality, or design capacity of the treatment works. If the treatment works has several different implementation schedules or is planning several improvements, submit separate responses to question B.5 for each. (If none, go to question B.6.)

- List the outfall number (assigned in question A.9) for each outfall that is covered by this implementation schedule.

- Indicate whether the planned improvements or implementation schedule are required by local, State, or Federal agencies.

☐ Yes ☐ No

FACILITY NAME AND PERMIT NUMBER:

Pine Forest Treatment Facility/AL0079634

Form Approved 1/14/99
OMB Number 2040-0086

- c. If the answer to B.5.b is "Yes," briefly describe, including new maximum daily inflow rate (if applicable).

- d. Provide dates imposed by any compliance schedule or any actual dates of completion for the implementation steps listed below, as applicable. For improvements planned independently of local, State, or Federal agencies, indicate planned or actual completion dates, as applicable. Indicate dates as accurately as possible.

Implementation Stage	Schedule	Actual Completion
	MM / DD / YYYY	MM / DD / YYYY
- Begin construction	___/___/___	___/___/___
- End construction	___/___/___	___/___/___
- Begin discharge	___/___/___	___/___/___
- Attain operational level	___/___/___	___/___/___

- e. Have appropriate permits/clearances concerning other Federal/State requirements been obtained? ☐ Yes ☐ No

Describe briefly: _____

B.6. EFFLUENT TESTING DATA (GREATER THAN 0.1 MGD ONLY).

Applicants that discharge to waters of the US must provide effluent testing data for the following parameters. Provide the indicated effluent testing required by the permitting authority for each outfall through which effluent is discharged. Do not include information on combined sewer overflows in this section. All information reported must be based on data collected through analysis conducted using 40 CFR Part 136 methods. In addition, this data must comply with QA/QC requirements of 40 CFR Part 136 and other appropriate QA/QC requirements for standard methods for analytes not addressed by 40 CFR Part 136. At a minimum, effluent testing data must be based on at least three pollutant scans and must be no more than four and one-half years old.

Outfall Number: _____

POLLUTANT	MAXIMUM DAILY DISCHARGE		AVERAGE DAILY DISCHARGE			ANALYTICAL METHOD	ML / MDL
	Conc.	Units	Conc.	Units	Number of Samples		
CONVENTIONAL AND NONCONVENTIONAL COMPOUNDS.							
AMMONIA (as N)							
CHLORINE (TOTAL RESIDUAL, TRC)							
DISSOLVED OXYGEN							
TOTAL KJELDAHL NITROGEN (TKN)							
NITRATE PLUS NITRITE NITROGEN							
OIL and GREASE							
PHOSPHORUS (Total)							
TOTAL DISSOLVED SOLIDS (TDS)							
OTHER							

END OF PART B.**REFER TO THE APPLICATION OVERVIEW TO DETERMINE WHICH OTHER PARTS OF FORM 2A YOU MUST COMPLETE**

FACILITY NAME AND PERMIT NUMBER:

Pine Forest Treatment Facility/AL0079634

Form Approved 1/14/99
OMB Number 2040-0086**BASIC APPLICATION INFORMATION****PART C. CERTIFICATION**

All applicants must complete the Certification Section. Refer to instructions to determine who is an officer for the purposes of this certification. All applicants must complete all applicable sections of Form 2A, as explained in the Application Overview. Indicate below which parts of Form 2A you have completed and are submitting. By signing this certification statement, applicants confirm that they have reviewed Form 2A and have completed all sections that apply to the facility for which this application is submitted.

Indicate which parts of Form 2A you have completed and are submitting:

Basic Application Information packet

Supplemental Application Information packet:

☐ Part D (Expanded Effluent Testing Data)☐ Part E (Toxicity Testing: Biomonitoring Data)☐ Part F (Industrial User Discharges and RCRA/CERCLA Wastes)☐ Part G (Combined Sewer Systems)**ALL APPLICANTS MUST COMPLETE THE FOLLOWING CERTIFICATION.**

I certify under penalty of law that this document and all attachments were prepared under my direction or supervision in accordance with a system designed to assure that qualified personnel properly gather and evaluate the information submitted. Based on my inquiry of the person or persons who manage the system or those persons directly responsible for gathering the information, the information is, to the best of my knowledge and belief, true, accurate, and complete. I am aware that there are significant penalties for submitting false information, including the possibility of fine and imprisonment for knowing violations.

Name and official title Robert PickneySignature Telephone number (615) 220-7200Date signed 06/17/2013

Upon request of the permitting authority, you must submit any other information necessary to assess wastewater treatment practices at the treatment works or identify appropriate permitting requirements.

SEND COMPLETED FORMS TO:

FACILITY NAME AND PERMIT NUMBER:
Pine Forest Treatment Facility/AL0079634

Form Approved 1/14/99
OMB Number 2040-0086

SUPPLEMENTAL APPLICATION INFORMATION


PART D. EXPANDED EFFLUENT TESTING DATA

Refer to the directions on the cover page to determine whether this section applies to the treatment works.

Effluent Testing: 1.0 mgd and Pretreatment Treatment Works. If the treatment works has a design flow greater than or equal to 1.0 mgd or it has (or is required to have) a pretreatment program, or is otherwise required by the permitting authority to provide the data, then provide effluent testing data for the following pollutants. Provide the indicated effluent testing information and any other information required by the permitting authority for each outfall through which effluent is discharged. Do not include information on combined sewer overflows in this section. All information reported must be based on data collected through analyses conducted using 40 CFR Part 136 methods. In addition, these data must comply with QA/QC requirements of 40 CFR Part 136 and other appropriate QA/QC requirements for standard methods for analytes not addressed by 40 CFR Part 136. Indicate in the blank rows provided below any data you may have on pollutants not specifically listed in this form. At a minimum, effluent testing data must be based on at least three pollutant scans and must be no more than four and one-half years old.

Outfall number: 0011 (Complete once for each outfall discharging effluent to waters of the United States.)

POLLUTANT	MAXIMUM DAILY DISCHARGE				AVERAGE DAILY DISCHARGE					ANALYTICAL METHOD	ML/ MDL
	Conc.	Units	Mass	Units	Conc.	Units	Mass	Units	Number of Samples		
METALS (TOTAL RECOVERABLE), CYANIDE, PHENOLS, AND HARDNESS.											
ANTIMONY	n/a										
ARSENIC	n/a										
BERYLLIUM	n/a										
CADMIUM	n/a										
CHROMIUM	n/a										
COPPER	n/a										
LEAD	n/a										
MERCURY	n/a										
NICKEL	n/a										
SELENIUM	n/a										
SILVER	n/a										
THALLIUM	n/a										
ZINC	n/a										
CYANIDE	n/a										
TOTAL PHENOLIC COMPOUNDS	n/a										
HARDNESS (AS CaCO ₃)	n/a										
Use this space (or a separate sheet) to provide information on other metals requested by the permit writer.											

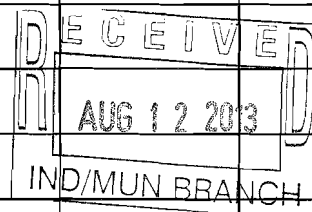


FACILITY NAME AND PERMIT NUMBER:
Pine Forest Treatment Facility/AL0079634

Form Approved 1/14/99
OMB Number 2040-0086

Outfall number: _____ (Complete once for each outfall discharging effluent to waters of the United States.)

POLLUTANT	MAXIMUM DAILY DISCHARGE				AVERAGE DAILY DISCHARGE					ANALYTICAL METHOD	ML/ MDL
	Conc.	Units	Mass	Units	Conc.	Units	Mass	Units	Number of Samples		
VOLATILE ORGANIC COMPOUNDS.											
ACROLEIN	n/a										
ACRYLONITRILE	n/a										
BENZENE	n/a										
BROMOFORM	n/a										
CARBON TETRACHLORIDE	n/a										
COLOROBENZENE	n/a										
CHLORODIBROMO-METHANE	n/a										
CHLOROETHANE	n/a										
2-CHLORO-ETHYL VINYL ETHER	n/a										
CHLOROFORM	n/a										
DICHLOROBROMO-METHANE	n/a										
1,1-DICHLOROETHANE	n/a										
1,2-DICHLOROETHANE	n/a										
TRANS-1,2-DICHLORO-ETHYLENE	n/a										
1,1-DICHLOROETHYLENE	n/a										
1,2-DICHLOROPROPANE	n/a										
1,3-DICHLORO-PROPYLENE	n/a										
ETHYLBENZENE	n/a										
METHYL BROMIDE	n/a										
METHYL CHLORIDE	n/a										
METHYLENE CHLORIDE	n/a										
1,1,2,2-TETRACHLORO-ETHANE	n/a										
TETRACHLORO-ETHYLENE	n/a										
TOLUENE	n/a										

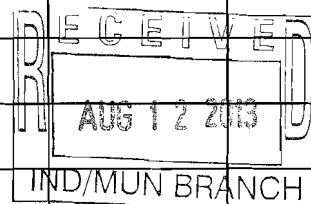

FACILITY NAME AND PERMIT NUMBER:
Pine Forest Treatment Facility/AL0079634

Form Approved 1/14/99
OMB Number 2040-0086

Outfall number: _____ (Complete once for each outfall discharging effluent to waters of the United States.)

POLLUTANT	MAXIMUM DAILY DISCHARGE				AVERAGE DAILY DISCHARGE					ANALYTICAL METHOD	ML/ MDL
	Conc.	Units	Mass	Units	Conc.	Units	Mass	Units	Number of Samples		
1,1,1-TRICHLOROETHANE	n/a										
1,1,2-TRICHLOROETHANE	n/a										
TRICHLORETHYLENE	n/a										
VINYL CHLORIDE	n/a										

Use this space (or a separate sheet) to provide information on other volatile organic compounds requested by the permit writer.

--	--	--	--	--	--	--	--	--	--	--	--

ACID-EXTRACTABLE COMPOUNDS

P-CHLORO-M-CRESOL	n/a										
2-CHLOROPHENOL	n/a										
2,4-DICHLOROPHENOL	n/a										
2,4-DIMETHYLPHENOL	n/a										
4,6-DINITRO-O-CRESOL	n/a										
2,4-DINITROPHENOL	n/a										
2-NITROPHENOL	n/a										
4-NITROPHENOL	n/a										
PENTACHLOROPHENOL	n/a										
PHENOL	n/a										
2,4,6-TRICHLOROPHENOL	n/a										

Use this space (or a separate sheet) to provide information on other acid-extractable compounds requested by the permit writer.

--	--	--	--	--	--	--	--	--	--	--	--

BASE-NEUTRAL COMPOUNDS.

ACENAPHTHENE	n/a										
ACENAPHTHYLENE	n/a										
ANTHRACENE	n/a										
BENZIDINE	n/a										
BENZO(A)ANTHRACENE	n/a										
BENZO(A)PYRENE	n/a										

FACILITY NAME AND PERMIT NUMBER:
Pine Forest Treatment Facility/AL0079634

Form Approved 1/14/99
OMB Number 2040-0086

Outfall number: _____ (Complete once for each outfall discharging effluent to waters of the United States.)

POLLUTANT	MAXIMUM DAILY DISCHARGE				AVERAGE DAILY DISCHARGE					ANALYTICAL METHOD	ML/ MDL
	Conc.	Units	Mass	Units	Conc.	Units	Mass	Units	Number of Samples		
3,4 BENZO-FLUORANTHENE	n/a										
BENZO(GHI)PERYLENE	n/a										
BENZO(K)FLUORANTHENE	n/a										
BIS (2-CHLOROETHOXY) METHANE	n/a										
BIS (2-CHLOROETHYL)-ETHER	n/a										
BIS (2-CHLOROISO-PROPYL) ETHER	n/a										
BIS (2-ETHYLHEXYL) PHTHALATE	n/a										
4-BROMOPHENYL PHENYL ETHER	n/a										
BUTYL BENZYL PHTHALATE	n/a										
2-CHLORONAPHTHALENE	n/a										
4-CHLORPHENYL PHENYL ETHER	n/a										
CHRYSENE	n/a										
DI-N-BUTYL PHTHALATE	n/a										
DI-N-OCTYL PHTHALATE	n/a										
DIBENZO(A,H) ANTHRACENE	n/a										
1,2-DICHLOROBENZENE	n/a										
1,3-DICHLOROBENZENE	n/a										
1,4-DICHLOROBENZENE	n/a										
3,3-DICHLOROBENZIDINE	n/a										
DIETHYL PHTHALATE	n/a										
DIMETHYL PHTHALATE	n/a										
2,4-DINITROTOLUENE	n/a										
2,6-DINITROTOLUENE	n/a										
1,2-DIPHENYLHYDRAZINE	n/a										

FACILITY NAME AND PERMIT NUMBER:
Pine Forest Treatment Facility/AL0079634

Form Approved 1/14/99
OMB Number 2040-0086

Outfall number: _____ (Complete once for each outfall discharging effluent to waters of the United States.)

POLLUTANT	MAXIMUM DAILY DISCHARGE				AVERAGE DAILY DISCHARGE					ANALYTICAL METHOD	ML/ MDL
	Conc.	Units	Mass	Units	Conc.	Units	Mass	Units	Number of Samples		
FLUORANTHENE	n/a										
FLUORENE	n/a										
HEXACHLOROBENZENE	n/a										
HEXACHLOROBUTADIENE	n/a										
HEXACHLOROCYCLO-PENTADIENE	n/a										
HEXACHLOROETHANE	n/a										
INDENO(1,2,3-CD)PYRENE	n/a										
ISOPHORONE	n/a										
NAPHTHALENE	n/a										
NITROBENZENE	n/a										
N-NITROSODI-N-PROPYLAMINE	n/a										
N-NITROSODI- METHYLAMINE	n/a										
N-NITROSODI-PHENYLAMINE	n/a										
PHENANTHRENE	n/a										
PYRENE	n/a										
1,2,4-TRICHLOROBENZENE	n/a										


Use this space (or a separate sheet) to provide information on other base-neutral compounds requested by the permit writer.

--	--	--	--	--	--	--	--	--	--	--	--

Use this space (or a separate sheet) to provide information on other pollutants (e.g., pesticides) requested by the permit writer.


--	--	--	--	--	--	--	--	--	--	--	--

END OF PART D.
REFER TO THE APPLICATION OVERVIEW TO DETERMINE WHICH OTHER PARTS OF FORM 2A YOU MUST COMPLETE

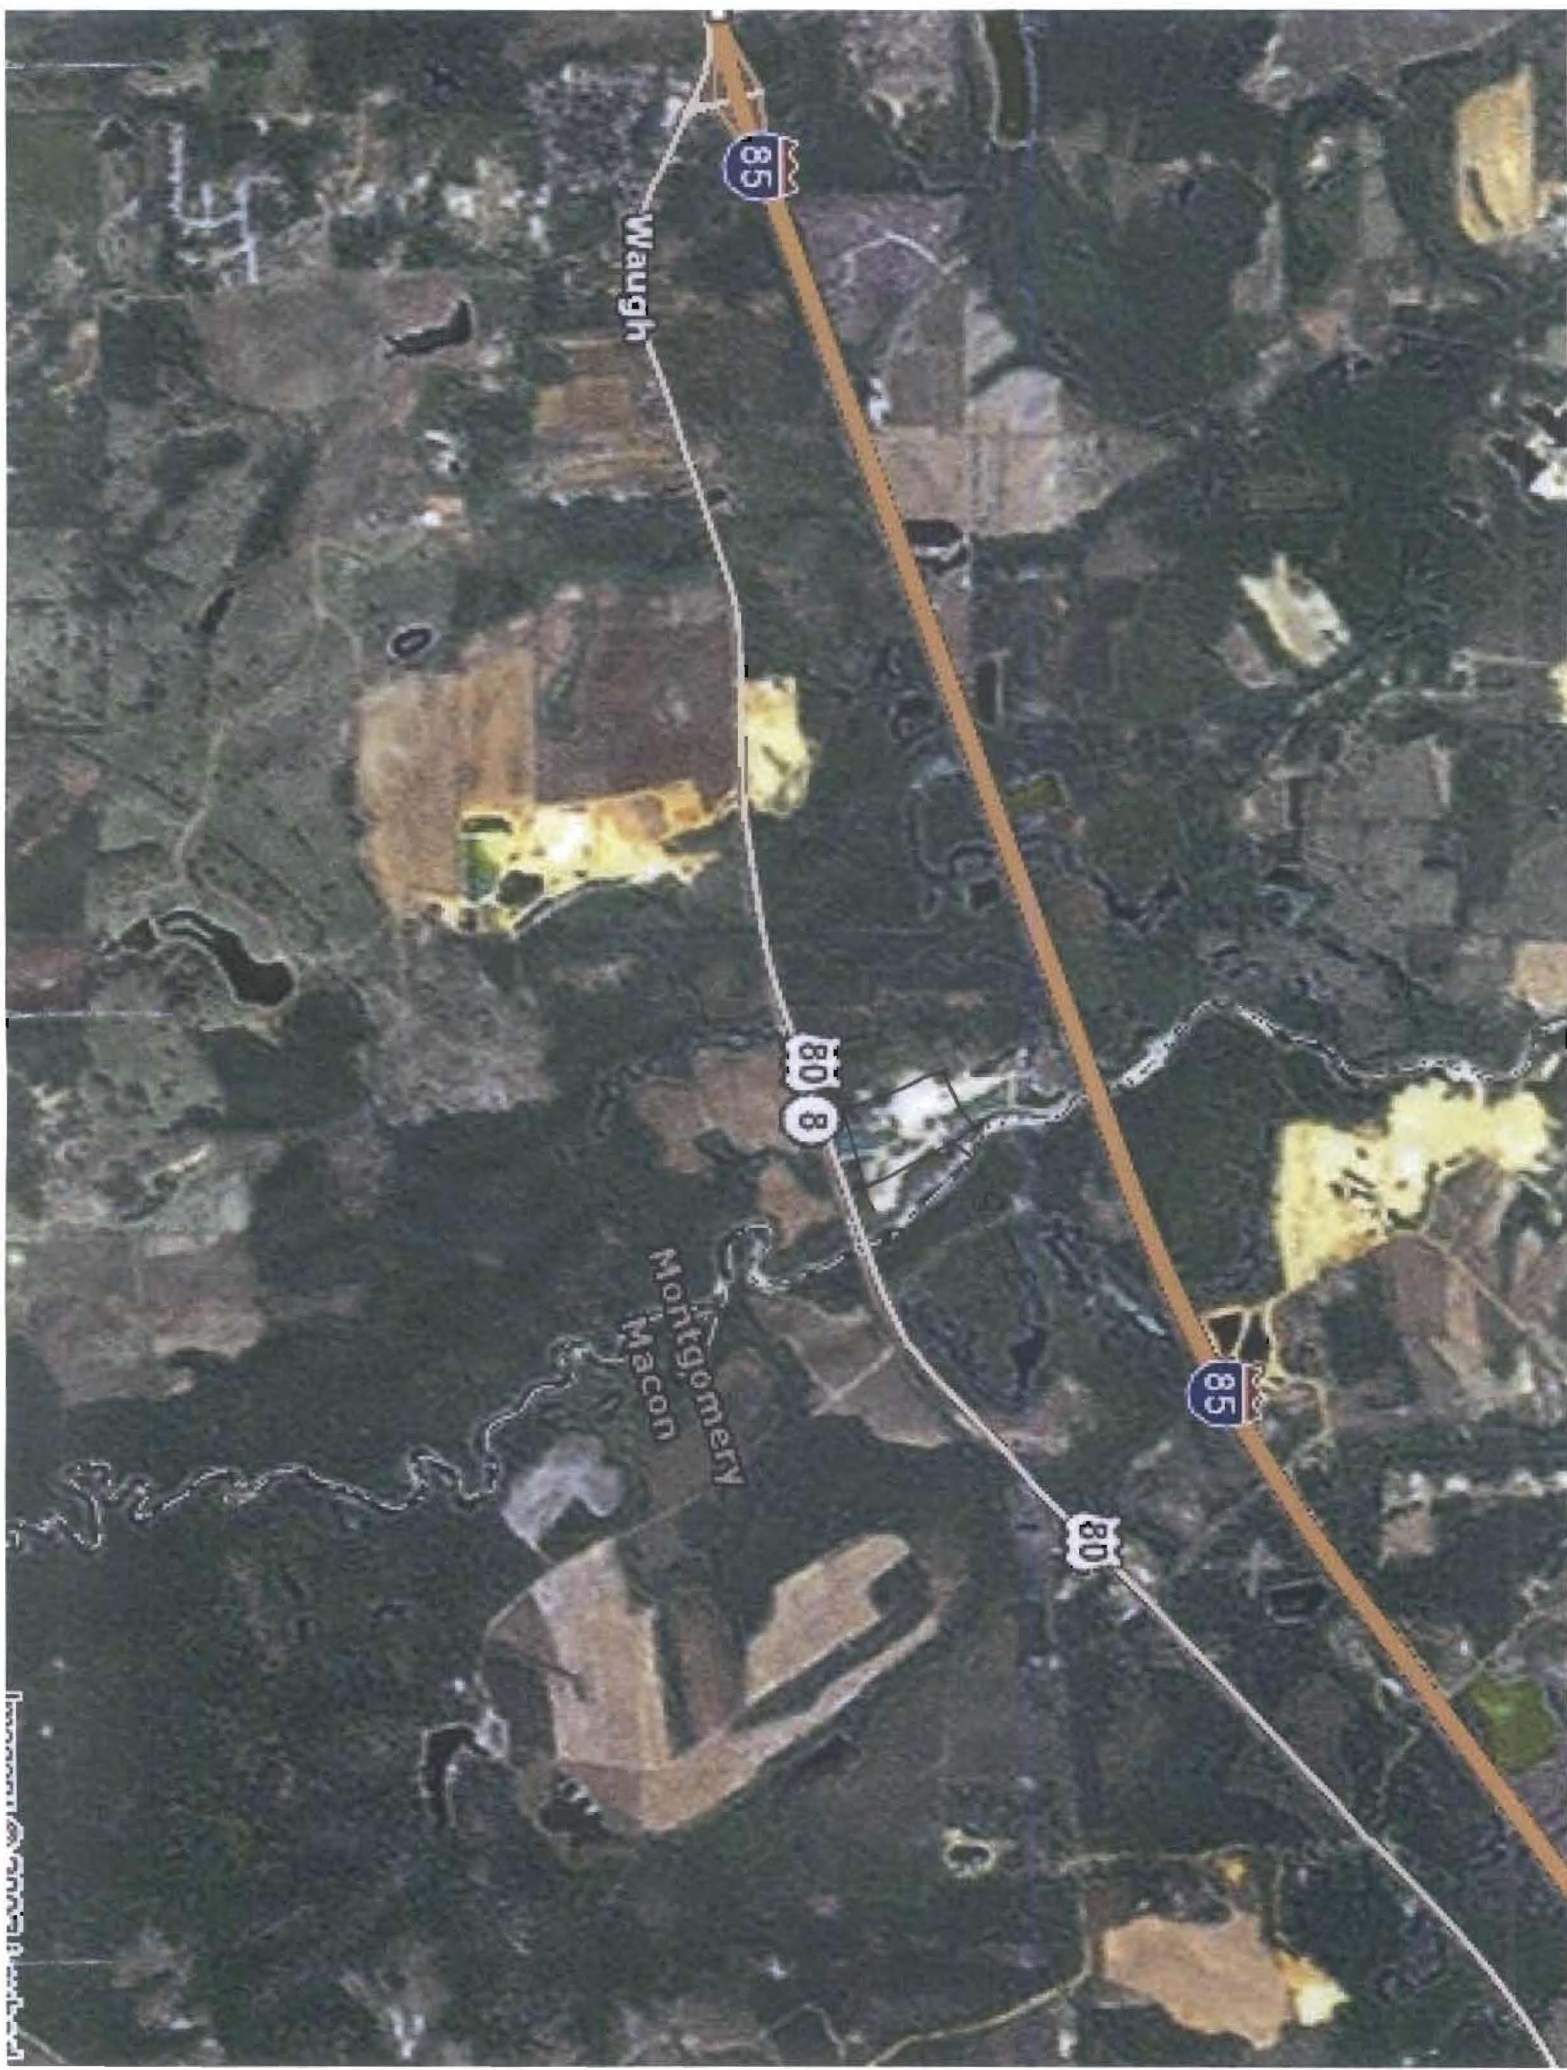

Pine Forest Flow Schemetic

Flow Meter Locations

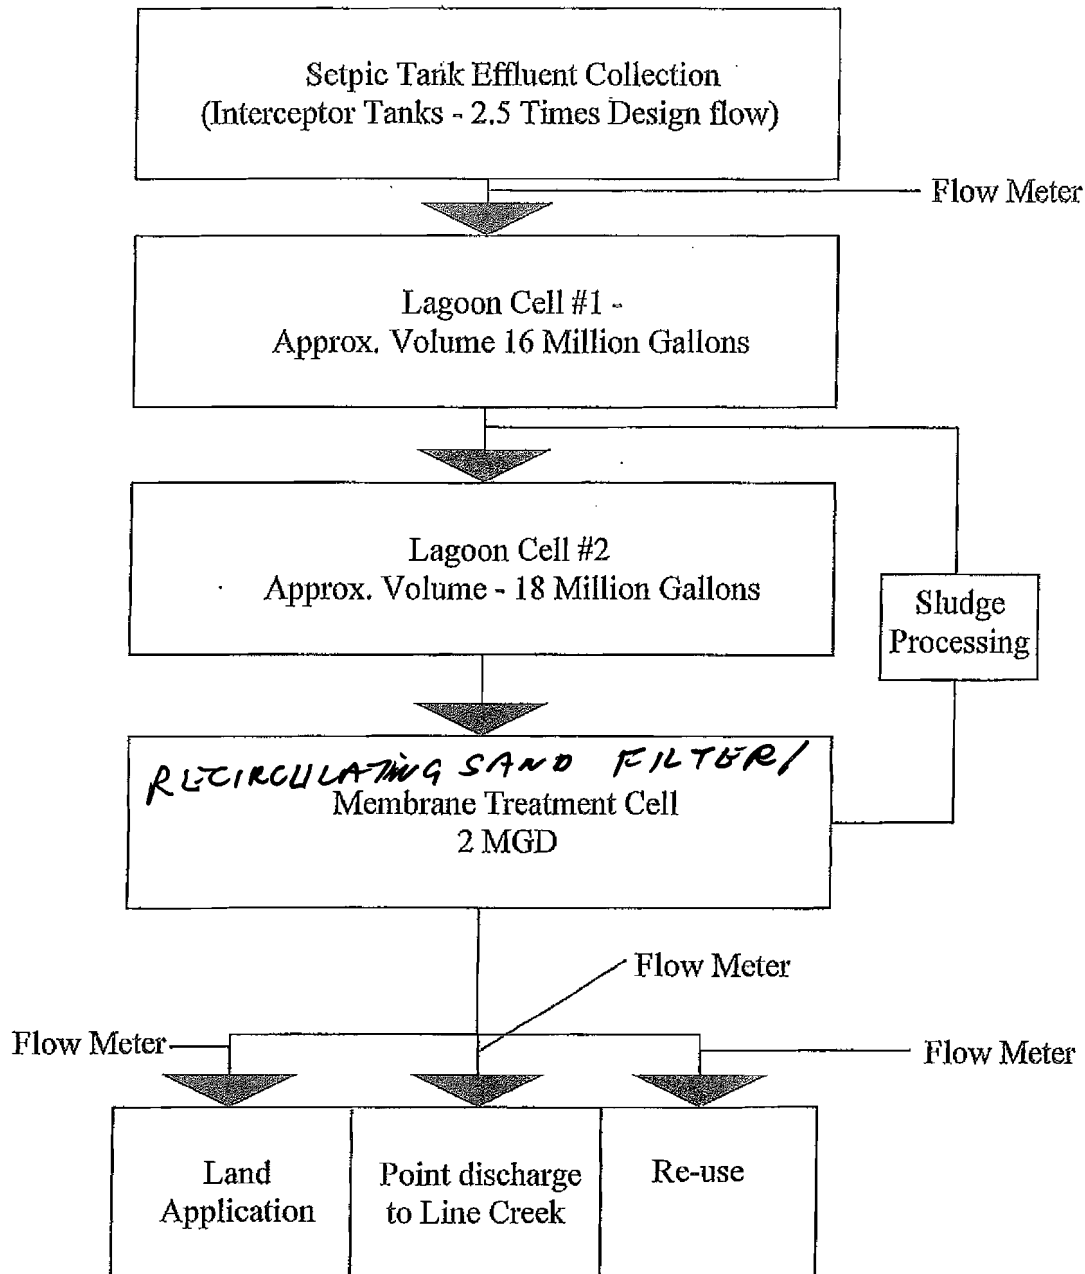

SUPPLEMENTARY INFORMATION
NATIONAL POLLUTANT DISCHARGE ELIMINATION SYSTEM (NPDES)
PERMIT APPLICATION FORM 188- Municipal, Semi-Public & Private Facilities

ALABAMA DEPARTMENT OF ENVIRONMENTAL MANAGEMENT
WATER DIVISION – MUNICIPAL PERMIT SECTION
POST OFFICE BOX 301463
MONTGOMERY, ALABAMA 36130-1463


INSTRUCTIONS: APPLICATIONS SHOULD BE TYPED OR PRINTED IN INK AND SUBMITTED TO THE DEPARTMENT. PLEASE CONTINUE ON AN ATTACHED SHEET OF PAPER IF INSUFFICIENT SPACE IS AVAILABLE TO ADDRESS ANY ITEM BELOW. PLEASE MARK N/A IN THE APPROPRIATE BOX WHEN AN ITEM IS NON-APPLICABLE TO THE APPLICANT.

PURPOSE OF THIS APPLICATION

☐ INITIAL PERMIT APPLICATION FOR NEW FACILITY ☐ INITIAL PERMIT APPLICATION FOR EXISTING FACILITY
☐ MODIFICATION OF EXISTING PERMIT ☒ REISSUANCE OF EXISTING PERMIT
☐ REVOCATION & REISSUANCE OF EXISTING PERMIT

SECTION A – GENERAL INFORMATION

1. Facility Name: Pine Forest Treatment Facility
- a. Operator Name: Alabama Wastewater Systems, Inc.
- b. Is the operator identified in 1.a, the owner of the facility? Yes ☒ No ☐
If no, provide name and address of the operator and submit information indicating the operator's scope of responsibility for the facility.
- c. Name of Permittee* if different than Operator: _____
*Permittee will be responsible for compliance with the conditions of the permit
2. NPDES Permit Number AL 0079634 (Not applicable if initial permit application)
3. Facility Location: **(Attach a map with location marked; street, route no. or other specific identifier)**
Street: Hwy 80 – Line Creek at Macon/Montgomery County Line
City: Pike Road County: Montgomery State: AL Zip: 36064
Facility (Front Gate) Location: Latitude (Deg Min Sec): 32.22.30 Longitude (Deg. Min Sec): 86.00.30
4. Facility Mailing Address (Street or Post Office Box): 851 Aviation Parkway
City: Smyrna County: Rutherford State: TN Zip: 37167
5. Responsible Official (as described on page 7 of this application):
Name and Title: Robert J. Pickney
Address: 849 Aviation Parkway
City: Smyrna State: TN Zip: 37167
Phone Number: 615-220-7200
Email Address: (Optional): _____

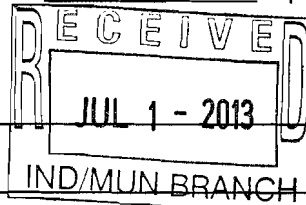

7. Please complete this section if the Applicant's business entity is a Proprietorship or limited liability Corporation with a responsible official not listed in Item 5.

a) Proprietor:

Name: _____

Address: _____

City: _____ State: _____ Zip: _____

8. Permit numbers for Applicant's previously issued NPDES Permits and identification of any other State Environmental Permits presently held by the Applicant within the State of Alabama:

Permit Name	Permit Number	Held by
Blackjack Treatment Plant	ALSI9958751	Alabama Wastewater Systems, LLC
Marler Tract WTP	ALSI9951673	Alabama Wastewater Systems, LLC
Pine Forest Wastewater Treatment Plant	ALSI9951770	Alabama Wastewater Systems, LLC

9. Identify all Administrative Complaints, Notices of Violation, Directives, or Administrative Orders, Consent Decrees, or Litigation concerning water pollution or other permit violations, if any against the Applicant within the State of Alabama in the past five years (attach additional sheets if necessary):

Facility Name	Permit Number	Type of Action	Date of Action
None			

SECTION A- WASTEWATER DISCHARGE INFORMATION

1. List the following historical monthly flow rates recorded for the past five years for each outfall:

Outfall Number	Highest in Last 12 Months MGD	Highest Daily Flow MGD	Average Flow MGD
1	n/a	n/a	n/a

2. Attached a process flow schematic of the treatment process, including the size of each unit operation.

3. Do you have, or plan to have, automatic sampling equipment or continuous wastewater flow metering equipment at this facility?

Current:	Flow Metering	Yes - <u> </u>	No <u> </u>	N/A <u> x </u>
	Sampling Equipment	Yes <u> </u>	No <u> </u>	N/A <u> x </u>
Planned:	Flow Metering	Yes <u> x </u>	No <u> </u>	N/A <u> </u>
	Sampling Equipment	Yes <u> x </u>	No <u> </u>	N/A <u> </u>

If so, please attach a schematic diagram of the sewer system indicating the present or future location of this equipment and describe the equipment below: Flow will be measured for incoming wastewater will be constantly monitored and flow of final discharge will be constantly monitored by a PLC that operates the system(s). Ultrasonic Meters will likely be used.

4. Are any wastewater collection or treatment modifications or expansions planned during the next three years that could alter wastewater volumes or characteristics? Yes x No

Briefly describe these changes and any potential or anticipated effects on the wastewater quality and quantity:
(Attach additional sheets if needed.)

The treatment/point discharge will be a part of a regional wastewater collection and disposal system for the Waters Development Community and surrounding area. The collection will be a watertight effluent system. All sources will have appropriately sized watertight septic tanks. The main trunk lines will be force mains. The proposed treatment site is approximately 235 acres. As much treated effluent as possible will be land applied subsurface via pressure compensating drip irrigation. Currently an UIC permit is in place that will permit up to 400,000 GPD to be applied via drip irrigation. However, due to relatively poor soils and high clay content, to be able to serve the wastewater needs for the Waters Development and surrounding area, a point discharge is also required to meet growth demands.

SECTION B – WASTE STORAGE AND DISPOSAL INFORMATION

Describe the location of all sites used for the storage of solids or liquids that have any potential for accidental discharge to a water of the state, either directly or indirectly via storm sewer, municipal sewer, municipal wastewater treatment plants, or other collection or distribution systems that are located at or operated by the subject existing or proposed NPDES-permitted facility. Indicate the location of any potential release areas and provide a map or detailed narrative description of the areas of concern as an attachment to this application:

Description of Waste
None

Description of Storage Location

Describe the location of any sites used for the ultimate disposal of solid or liquid waste materials or residuals (e.g. sludges) generated by any wastewater treatment system located at the facility.

Description of Waste	Quantity (lbs/day)	Disposal Method*
Process Sludge	100 dry lbs	Onsite treatment

*Indicate any wastes disposed at an off-site treatment facility and any wastes that are disposed on-site

SECTION C – INDUSTRIAL INDIRECT DISCHARGE CONTRIBUTORS

1. List the existing and proposed industrial source wastewater contributions to the municipal wastewater treatment system (Attach other sheets if necessary)

Company Name	Description of Industrial Wastewater	Existing or Proposed	Flow (MGD)	Subject to SID Permit? Y/N

2. Are industrial wastewater contributions regulated via a locally approved sewer use ordinance [Y/N]? If so, please attach a copy of the ordinance.
N/A

SECTION D – COASTAL ZONE INFORMATION

Is the discharge(s) located within the 10-foot elevation contour and within the limits of Mobile or Baldwin County?
Yes [] No [x] If yes, then complete items A through M below:

	YES	NO
A. Does the project require new construction?	_____	_____
B. Will the project be a source of new air emissions?	_____	_____
C. Does the project involve dredging and/or filling of a wetland area or water way?	_____	_____
Has the Corps of Engineers (COE) permit been issued?	_____	_____
Corps Project Number _____		
D. Does the project involve wetlands and/or submersed grassbeds?	_____	_____
E. Are oyster reefs located near the project site? (Include a map showing project and discharge location with respect to oyster reefs)	_____	_____
F Does the project involve the site development, construction and operation of an energy facility as defined in ADEM Admin. Code R. 335-8-1-.02(bb)?	_____	_____
G. Does the project involve mitigation of shoreline or costal area erosion?	_____	_____
H. Does the project involve construction on beaches or dunes areas?	_____	_____
I. Will the project interfere with public access to coastal waters?	_____	_____
J. Does the project lie within the 100-year floodplain?	_____	_____
K. Does the project involve the registration, sale, use, or application of pesticides?	_____	_____
L. Does the project propose or require construction of a new well or to alter an existing groundwater well to pump more than 50 gallons per day (GPD)?	_____	_____
M. Has the applicable permit for groundwater recovery or for groundwater well installation been obtained?	_____	_____

SECTION E- ANTI-DEGRADATION EVALUATION

It is the applicant's responsibility to demonstrate the social and economic importance of the proposed activity, if subject to antidegradation requirements. In accordance with 40 CFR 131.12 and Section 335-6-10-.04 of the Alabama Department of Environmental Management Administrative Code, the following information must be provided, if applicable. If further information is required to make this demonstration, attach additional sheets to the application.

1. Is this a new or increased discharge that began after April 3, 1991? Yes [☐] No [☒].
If "yes", complete question 2 below. If "no", do not complete this section.
2. Has an Anti-Degradation Analysis been previously conducted and submitted to the Department for the new or increased discharge referenced in question 1? Yes [☐] No [☐].

If "no", complete questions A through F below and also ADEM forms 311 and 312 or 313, whichever is applicable, (attached). Form 312 or 313, whichever is applicable, must be provided for each treatment discharge alternative considered technically viable. If "yes", do not complete this section.

Information required for new or increased discharges to high quality waters:

- A. What environmental or public health problem will the discharger be correcting?
The Waters Development and surrounding area is in the early stages of significant growth. This area has very limited wastewater infrastructure. The soils in the area are prairie type soils, which severely limit the installation of conventional septic tank systems. There are many existing failing septic tank systems in the area, and if public sewer is not made available there will be many more in the future.
- B. Explain if and to what degree the discharger will be increasing employment as a result of the proposed discharge, either at its existing facility or as the result of the start-up of a related new facility or industry.
The Waters Development and surrounding community has several thousand planned new homes, along with accompanying commercial growth. Without effective wastewater service, the community cannot have effective planning or development especially for schools and commercial development. There will be hundreds of jobs created by the development of this area.
- C. Explain if and to what degree the discharge will prevent employment reductions?
Without wastewater service the community will not be able to continue to grow. If the growth slows or stops, many present jobs, especially in the construction industry would be lost.
- D. Describe any additional state or local taxes that the prospective discharger will be paying.
The prospective discharger- Alabama Wastewater Systems LLC, is a Public Utility Company and as such pays the same taxes as any company routinely engaged in business in Alabama. A fee is also paid to the City of Pike Road for providing wastewater service.
- E. Describe any public service the discharger will be providing to the community.
Alabama Wastewater Systems, LLC will be making available to all citizens wastewater service on a voluntary basis. No one will be forced to tie into the system, but it is available if needed. The environmental quality of the planned community will be of a higher standard if wastewater service is available. The quality of life with a well planned community will be substantially better if community sewer is available. The Waters Development is Master Planned to have over 2500 homes plus commercial development. Alabama Wastewater Systems, LLC has committed to serve this entire development plus many others in the area. The City of Pike Road has encouraged the development of this system for this area.
- F. Describe the economic or social benefit the discharger will be providing to the community.
There is a tremendous economic and social benefit when a community can be master planned with sewer service versus when it does not have sewer service. The Pike Road community is placing a high emphasis on preserving open space and natural resources. Sewer service is an essential component to plan these types of communities. A significant social benefit can be achieved by creating a more efficient community, properly planned to maximize desired lifestyles. Commercial and professional services can be integrated into the planned community only if public wastewater service is available.

SECTION F – EPA Application Forms

All Applicants must submit certain EPA permit application forms. More than one application form may be required from a municipal facility depending on the number and types of discharges or outfalls. The EPA application forms are found on the Department's website at <http://www.adem.state.al.us/> and are also listed in Attachment 4. The EPA application forms must be submitted to ADEM in duplicate.

SECTION G– ENGINEERING REPORT/BMP PLAN REQUIREMENTS

Any Engineering Report or Best Management Practice (BMP) Plans required to be submitted to ADEM by the applicant must be in accordance with ADEM 335-6-6-.08(i) & (j).


SECTION H– APPLICATION CERTIFICATION

THE INFORMATION CONTAINED IN THIS FORM MUST BE CERTIFIED BY A RESPONSIBLE OFFICIAL AS DEFINED IN ADEM ADMINISTRATIVE RULE 335-6-6-.09 "SIGNATORY REQUIREMENTS FOR PERMIT APPLICATIONS" (SEE BELOW).

"I CERTIFY UNDER PENALTY OF LAW THAT THIS DOCUMENT AND ALL ATTACHMENTS WERE PREPARED UNDER MY DIRECTION OR SUPERVISION IN ACCORDANCE WITH A SYSTEM DESIGNED TO ASSURE THAT QUALIFIED PERSONNEL PROPERLY GATHER AND EVALUATE THE INFORMATION SUBMITTED. BASED ON MY INQUIRY OF THE PERSON OR PERSONS WHO MANAGE THE SYSTEM, OR THOSE PERSONS DIRECTLY RESPONSIBLE FOR GATHERING THE INFORMATION, THE INFORMATION SUBMITTED IS, TO THE BEST OF MY KNOWLEDGE AND BELIEF, TRUE, ACCURATE, AND COMPLETE. I AM AWARE THAT THERE ARE SIGNIFICANT PENALTIES FOR SUBMITTING FALSE INFORMATION INCLUDING THE POSSIBILITY OF FINE AND IMPRISONMENT FOR KNOWING VIOLATIONS."

"I FURTHER CERTIFY UNDER PENALTY OF LAW THAT THE RESULTS OF ANY ANALYSES REPORTED AS LESS THAN DETECTABLE IN THIS APPLICATION OR IN ATTACHMENTS THERETO WERE PERFORMED USING THE EPA APPROVED TEST METHOD HAVING THE LOWEST DETECTION LIMIT READILY ACHIEVABLE FOR THE SUBSTANCE TESTED."

SIGNATURE OF
RESPONSIBLE OFFICIAL:

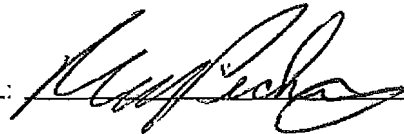

DATE
SIGNED: 6/17/2013

(TYPE OR PRINT)

NAME OF RESPONSIBLE OFFICIAL:

Robert Pickney

OFFICIAL TITLE OF RESPONSIBLE OFFICIAL:

Chief Technical Officer

MAILING ADDRESS:

849 Aviation Parkway, Smyrna, TN 37167

AREA CODE & PHONE NUMBER:

615-220-7200

SIGNATORY REQUIREMENTS FOR PERMIT APPLICATIONS

Responsible official is defined as follows:

1. In the case of a municipal, state, federal, or other public facility, the responsible official is either a principal executive officer or a ranking elected official of the municipality or other public entity.
2. In the case of a private or semi-public facility, the responsible official is either a principal executive officer or the owner of the corporation or other entity.

Attachment 1 to Supplementary Form ADEM Form 311


Alternatives Analysis

Applicant/Project: Alabama Wastewater Systems, Inc. / Pine Forest Treatment System

All new or expanded discharges (except discharges eligible for coverage under general permits) covered by the NPDES permitting program are subject to the provisions of ADEM's antidegradation policy. Applicants for such discharges to Tier 2 waters are required to demonstrate "... that the proposed discharge is necessary for important economic or social development." As a part of this demonstration, the applicant must complete an evaluation of the discharge alternatives listed below, including a calculation of the total annualized project costs for each technically feasible alternative (using ADEM Form 312 for public-sector projects and ADEM Form 313 for private-sector projects). Alternatives with total annualized project costs that are less than 110% of the total annualized project costs for the Tier 2 discharge proposal are considered viable alternatives.

Alternative	Viable	Non-Viable	Comment
1 Land Application		x	This will be a combination Permit including land application
2 Pretreatment/Discharge to POTW		x	Capacity not available at a cost effective cost in the area
3 Relocation of Discharge		x	Expansion of Existing Facility
4 Reuse/Recycle		x	Part of the sewer development plan, but not able to take entire flow
5 Process/Treatment Alternatives		x	Permit is part a comprehensive Plan
6 On-site/Sub-surface Disposal		x	Very poor soils in the proposed service area
<i>(other project-specific alternatives considered by the applicant; attach additional sheets if necessary)</i>			
7			
8			
9			

Pursuant to ADEM Administrative Code Rule 335-6-3-.04, I certify on behalf of the applicant that I have completed an evaluation of the discharge alternatives identified above, and reached the conclusions indicated.

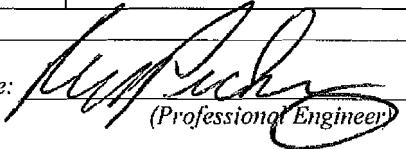Signature:  (Professional Engineer)

Date: 6/17/2013

(Supporting documentation to be attached, referenced, or otherwise handled as appropriate.)

Attachment 2 to Supplementary Form

Calculation of Total Annualized Project Costs for Public-Sector Projects

A. Capital Costs

Capital Cost of Project \$ _____

Other One-Time Costs of Project (Please List, if any):

_____ \$ _____
_____ \$ _____
_____ \$ _____

Total Capital Costs (Sum column) \$ _____ (1)

Portion of Capital Costs to be Paid for with Grant Monies \$ 0 (2)

Capital Costs to be Financed [Calculate: (1) – (2)] \$ _____ (3)

Type of Financing (e.g., G.O. bond, revenue bond, bank loan) _____

Interest Rate for Financing (expressed as decimal) _____ (i)

Time Period of Financing (in years) _____ (n)

Annualization Factor = $\frac{i}{(1+i)^n - 1} + i$ _____ (4)

Annualized Capital Cost [Calculate: (3) x (4)] _____ (5)

B. Operating and Maintenance Costs

Annual Costs of Operation and Maintenance (including but not limited to: monitoring, inspection, permitting fees, waste disposal charges, repair, administration and replacement.) (Please list below.)

_____ \$ _____
_____ \$ _____
_____ \$ _____
_____ \$ _____

Total Annual O & M Costs (Sum column) \$ _____ (6)

C. Total Annual Cost of Pollution Control Project

Total Annual Cost of Pollution Control Project [(5) + (6)]

\$ _____ (7)

Attachment 3 to Supplementary Form ADEM Form 313

Calculation of Total Annualized Project Costs for Private-Sector Projects

Capital Costs to be Financed (Supplied by applicant)	<u>2,500,000</u>
Interest rate for Financing (Expressed as a decimal)	<u>.075</u>
Time Period of Financing (Assume 10 years [*])	<u>10 years (n)</u>
Annualization Factor = $\frac{i}{(1+i)^{10} - 1} + i$	<u>0.11</u>
Annualized Capital Cost [Calculate: (1) x (2)]	<u>\$ 275,000</u>
Annual Cost of Operation and Maintenance (including but not limited to monitoring, inspection, permitting fees, waste disposal charges, repair, administration and replacement) ^{**}	<u>300,000</u>
Total Annual Cost of Pollution Control Project [(3) + (4)]	<div style="border: 1px solid black; padding: 5px; display: inline-block;">\$575,000</div>

* While actual payback schedules may differ across projects and companies, assume equal annual payments over a 10-year period for consistency in comparing projects.

** For recurring costs that occur less frequently than once a year, pro rate the cost over the relevant number of years (e.g., for pumps replaced once every three years, include one-third of the cost in each year).

Attachment 4 to Supplementary Form

NPDES PROGRAM PERMIT APPLICATION FORMS ALABAMA DEPARTMENT OF ENVIRONMENTAL MANAGEMENT

TYPE DISCHARGE	ADEM FORMS	EPA FORMS
New or existing once through non-contact cooling water and/or cooling tower blowdown, and/or sanitary wastewater (non-process wastewater only). Note: POTWs must use Form 2A.	Supplemental Information Form 187 – (Industrial) or Form 188 (Municipal)	Forms 1 and 2E
Existing discharges of process wastewater	Supplemental Information Form 187 – (Industrial) or Form 188 (Municipal)	Forms 1 and 2C
New discharges of process wastewater	Supplemental Information Form 187 – (Industrial) or Form 188 (Municipal)	Forms 1 and 2D
New or existing discharges composed entirely of stormwater meeting the EPA definition of stormwater associated with industrial activity	Supplemental Information Form 187 – (Industrial) or Form 188 (Municipal)	Forms 1 and 2F
New or existing discharges composed of stormwater meeting the EPA definition of stormwater associated with industrial activity, and any other non-stormwater discharges.	Supplemental Information Form 187 – (Industrial) or Form 188 (Municipal)	Forms 1 and 2F and, as appropriate, Forms 2E, 2C, and/or 2D
New or existing Publicly-Owned Treatment Works (POTWs) and Privately-Owned Treatment Works composed of sanitary wastewater	Supplemental Information Form 187 – (Industrial) or Form 188 (Municipal)	Forms 1 and 2A
New or existing land application of process wastewater. Form 2F is required for stormwater runoff from the land application site, if the site is not completely bermed to prevent runoff.	Supplemental Information Form 187	Forms 1, 2F, and 2C or 2D, as appropriate
New or existing land application of sanitary wastewater. Form 2F is required for stormwater runoff from the land application site, if the site is not completely bermed to prevent runoff.	Supplemental Information Form 187 – (Industrial) or Form 188 (Municipal)	Forms 1, 2F, and 2A or 2E, as appropriate

Testing requirements: Test procedures for all analyses shall conform to 40 CFR Part 136. If more than one method of analysis is approved, then the method having the lowest detection level shall be used. Any facilities discharging to mercury impaired surface waters identified by EPA or ADEM [as identified on the latest §303(d) List] and any facility with a discharge that has reasonable

potential to cause in-stream exceedence of a Water Quality Based Effluent Limit (WQBEL) shall be required to use EPA Method 1631E.



849 Aviation Parkway
Smyrna, TN 37167

June 17, 2013

Ms. Shanda Torbert
ADEM
Municipal Section
1400 Coliseum Blvd.
Montgomery AL 36130

RE: NPDES Permit – Pine Forest Wastewater Treatment Plant

Dear Shanda:

Enclosed are the application forms for the renewal of the NPDES permit for the Pine Forest Wastewater Treatment Plant. This facility is planned to provide wastewater service for the Waters Development and surrounding areas near the town of Pike Road. An existing permit for underground injection, ALSI9951770 has been issued previously by ADEM. Alabama Wastewater Services, LLC conceives a wastewater facilities plan that utilizes a combination of land application, reuse and point discharge. The favored method of disposal will be via micro drip irrigation into the topsoil layer within the local area. The second will be to produce "re-use quality" water via activated sludge and membrane filtration to be distributed throughout the service territory. Unfortunately, no large users have been identified as of yet, but this option usually requires water to be available before users are willing to commit to accepting the water. If the previous options are not available for whatever reason, then the point discharge will need to be utilized. Tentative commitments and projected growth in the area will require a 2 MGD facility.


The technologies involved with this system will be effluent collection, to lagoon treatment/storage. This system has been permitted and has been constructed. Tertiary treatment will be via recirculating sand filter and/or activated sludge/membrane filtration. A Kabota membrane facility is planned. Experience has shown that this technology can consistently meet the extremely difficult limits proposed by the waste load allocation study performed by ADEM.

Enclosed is a check for the application fee of \$3925.00. The waste load allocation study was previously requested and paid for.

If more information is needed, please let me know.

Sincerely,

Robert Pickney, P.E.
Chief Technical Officer

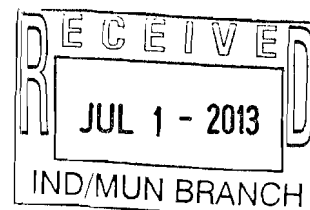

July 31, 2013,

Re: NPDES monitoring of storm water runoff at Pine Forest WWTF not needed

To whom it may concern,

This letter is to inform ADEM that storm water runoff monitoring at the Pine Forest WWTF is not needed thru the NPDES permit. All storm water drainage from the treatment system will go to internal ponds remaining from a sand/gravel operation at the site previously. There would be no storm water point source discharge to the surface waters.

If you have any questions please feel free to contact me.

Brian Carter



Adenus Utilities Group